



FLEXtra PROFINET-Switch 16-Port
FLEXtra PROFINET-Switch FO 16-Port
FLEXtra PROFINET-Switch FO 10-Port

Manual

Version 3 | 27.10.2023 | for firmware V1.10 and above

Order numbers: 700-855-16P01, 700-856-12F41, 700-856-8FO21



Link to newest version of
manual

Notes

All rights reserved, including those related to the translation, reprinting, and reproduction of this manual or of parts thereof.

No part of this manual may be reproduced, processed, duplicated, or distributed in any form (photocopy, microfilm, or any other methods), even for training purposes or with the use of electronic systems, without written approval from Helmholtz GmbH & Co. KG.

All rights reserved in the event of the granting of a patent or the registration of a utility model.

To download the latest version of this manual, please visit our website at www.helmholz.de.

We welcome all ideas and suggestions.

Copyright © 2023 by

Helmholz GmbH & Co. KG

Hannberger Weg 2 | 91091 Großenseebach

All trademarks shown or mentioned in this document are the property of their respective owners or manufacturers. The representation and naming serve exclusively to explain the use and setting options of the products documented here.

Revision Record:

Version	Date	Change
1	5/20/2021	First version for Firmware V1.04
2	26.10.2021	VLAN description clarified Adjustments for firmware V1.06 Update security recommendations PROFINET FAQ updated
3	27.10.2023	FLEXtra PN-Switch FO 16-/10-Port added Correction at "Setting the port properties" Added SNMP V3

Contents

1	General	6
1.1	Structure of the manual	6
1.2	Target audience for this manual	6
1.3	Safety instructions	6
1.4	Note symbols and signal words	7
1.5	Intended use	8
1.6	Improper use	8
1.7	Liability	9
1.7.1	Disclaimer of liability	9
1.7.2	Warranty	9
1.8	Open Source	9
2	Security recommendations	10
3	System overview	12
3.1	Setup	13
3.2	Taster	14
3.2.1	"RST"-Taster (Reset)	14
3.2.2	"FCN"-Taster (Function)	14
3.3	Status LEDs	14
3.4	System LEDs	14
3.5	Ethernet LEDs (RJ45 and SFP)	15
4	Installation and removal	16
4.1	Access restriction	16
4.2	Mounting and minimum distances	16
4.3	Electrical installation	16
4.4	Protection against electrostatic discharges	16
4.5	EMC protection	17
4.6	Operation	17
4.7	Recycling / WEEE	17
5	Preparing the FLEXtra PROFINET-Switch	18
5.1	Connection	18
5.2	Install GSDML file	19
5.3	Setup in the hardware-configuration	19
5.4	Setting the port properties	21

5.5	Use of SFP modules	22
5.6	Setup of SFP modules	23
5.7	Topology detection	24
5.8	Assign the PROFINET switch a name	25
5.9	Media redundancy protocol (MRP)	26
6	Configuration and diagnostics via the web interface	27
6.1	Login	27
6.2	“System” menu	27
6.2.1	Status	28
6.2.2	Network configuration	29
6.2.3	Restart and Factory Reset	30
6.2.4	Password	30
6.2.5	Event Logging	31
6.2.6	Firmware Upgrade	31
6.2.7	Saving and restoring a configuration	32
6.2.8	Time Settings	33
6.2.9	Certificates for website	33
6.3	„Agent“ menu	34
6.3.1	Web	34
6.3.2	Identification & Maintenance	34
6.3.3	PROFINET Scan	35
6.3.4	SNMP V2/V3	36
6.3.5	Topology („Ring Redundancy“)	37
6.4	„Switch“ menu	38
6.4.1	Port Status	38
6.4.2	Port Mirroring	38
6.4.3	ARP-Table	39
6.4.4	LLDP	39
6.4.5	DCP boundaries	40
6.4.6	Preferential forwarding of time-critical data („CoS“)	41
6.4.7	Port Forwarding rules („MAC Table“)	42
6.4.8	VLAN configuration	43
6.5	Network statistics (“Statistics“ menu)	46
6.5.1	„Statistics By Size“	46

6.5.2	„Statistic By Type“	46
6.5.3	„Statistics By Error“	46
7	Status and control in the PLC.....	47
8	Status and control via digital inputs/outputs	49
9	PROFINET FAQ	50
9.1	Why do you need a PROFINET switch for a PROFINET network?	50
9.2	Is the PROFINET switch “real time-compatible”?	50
9.3	What do the LEDs BF and SF mean?	51
9.4	What is “Device exchange during operation”, and what role does the PROFINET switch play here?	51
9.5	Why should PROFINET devices have PROFINET certification?.....	51
9.6	What is behind the PROFINET conformance classes A, B, C?	51
9.7	Can the PROFINET switch also transmit 1 GBit?.....	52
9.8	Which Ethernet cable types can be used for PROFINET?	52
9.9	Can PROFI-safe be transmitted via the PROFINET switch?	52
9.10	Why does the PROFINET switch have its own IP address and a PROFINET name?.....	52
9.11	What are I&M data?.....	52
9.12	Can I also use the PROFINET switch in other industrial networks without PROFINET?	52
9.13	What happens with a PROFINET participant when the power supply fails?	52
9.14	Why is “Port Mirroring” necessary?.....	53
9.15	Do the PROFINET switches support TSN?.....	53
9.16	More information on PROFINET	53
10	Technical data.....	54
10.1	FLEXtra PROFINET-Switch 16-port.....	54
10.2	FLEXtra PROFINET-Switch FO 16-port	55
10.3	FLEXtra PROFINET-Switch FO 10-port	56

1 General

This operating manual applies only to devices, assemblies, software, and services of Helmholtz GmbH & Co. KG.

1.1 Structure of the manual

This manual is divided into 10 sections.

[Section 1](#) contains general information and safety instructions.

[Section 2](#) refers to Security Recommendations.

[Section 3](#) explains the system overview and features of the product.

[Section 4](#) explains the installation and removal.

[Section 5](#) shows the initial commissioning with connection and GSDML configuration.

The configuration and diagnostics of the switch via the web interface are explained in [section 6](#).

[Section 7](#) explains the status and control bits in the EA image in the PLC.

The use of the digital inputs and outputs is described [section 8](#).

[Section 9](#) contains a FAQ about PROFINET.

The technical data are documented in [section 10](#).

1.2 Target audience for this manual

This description is only intended for trained personnel qualified in control and automation engineering who are familiar with the applicable national standards. For installation, commissioning, and operation of the components, compliance with the instructions and explanations in this operating manual is essential.



Configuration, execution, and operating errors can interfere with the proper operation of the FLEXtra PROFINET Switch and result in personal injury, as well as material or environmental damage. Only suitably qualified personnel may operate the devices!

Qualified personnel must ensure that the application and use of the products described meet all the safety requirements, including all relevant laws, regulations, provisions, and standards.

1.3 Safety instructions

The safety instructions must be observed in order to prevent harm to living creatures, material goods, and the environment. The safety notes indicate possible hazards and provide information about how hazardous situations can be prevented.

1.4 Note symbols and signal words



HAZARD

If the hazard warning is ignored, there is an imminent danger to life and health of people from electrical voltage.



WARNING

If the warning is ignored, there is a probable danger to life and health of people.



CAUTION

If the caution note is ignored, people can be injured or harmed.



ATTENTION

Draws attention to sources of error that can damage equipment or the environment.



NOTE

Gives an indication for better understanding or preventing errors.

1.5 Intended use

The FLEXtra PROFINET-Switch (hereinafter referred to as "the device") can be used for networking Ethernet networks. The FLEXtra PROFINET switch supports the PROFINET protocol and other managed Ethernet functions.

All components are supplied with a factory hardware and software configuration. The user must carry out the hardware and software configuration for the conditions of use. Modifications to hardware or software configurations which are beyond the documented options are not permitted and nullify the liability of Helmholz GmbH & Co. KG.

The device may not be used as the only means for preventing hazardous situations on machinery and systems.

The FLEXtra PROFINET switch cannot be used for a direct connection to the Internet. Always use a dedicated router with a sufficiently dimensioned Internet firewall for an Internet connection. Observe the security recommendations for project planning, use and maintenance.

Problem-free and safe operation of the device presumes proper transport, storage, setup, assembly, installation, commissioning, operation, and maintenance.

The ambient conditions provided in the technical specifications must be adhered to.

The device has a protection rating of IP20 and must be installed in an electrical operating room or a control box/cabinet to protect it against environmental influences. To prevent unauthorized access, the doors of control boxes/cabinets must be closed and possibly locked during operation.

1.6 Improper use



The consequences of improper use may include personal injuries of the user or third parties as well as property damage to the control system, the product, or the environment. Use the FLEXtra PROFINET-Switch only as intended!

1.7 Liability

The contents of this manual are subject to technical changes resulting from the continuous development of products of Helmholz GmbH & Co. KG. In the event that this manual contains technical or clerical errors, we reserve the right to make changes at any time without notice.

No claims for modification of delivered products can be asserted based on the information, illustrations, and descriptions in this documentation. Beyond the instructions contained in the operating manual, the applicable national and international standards and regulations must also be observed in any case.

1.7.1 Disclaimer of liability

Helmholz GmbH & Co. KG is not liable for damages if these were caused by use or application of products that was improper or not as intended.

Helmholz GmbH & Co. KG assumes no responsibility for any printing errors or other inaccuracies that may appear in the operating manual unless there are serious errors about which Helmholz GmbH & Co. KG was already demonstrably aware.

Beyond the instructions contained in the operating manual, the applicable national and international standards and regulations must also be observed in any case.

Helmholz GmbH & Co. KG is not liable for damage caused by software that is running on the user's equipment which compromises, damages, or infects additional equipment or processes through the remote maintenance connection and which triggers or permits unwanted data transfer.

1.7.2 Warranty

Report any defects to the manufacturer immediately after discovery of the defect.

The warranty is not valid in case of:

- Failure to observe these operating instructions
- Use of the device that is not as intended
- Improper work on and with the device
- Operating errors
- Unauthorized modifications to the device

The agreements met upon contract conclusion under "General Terms and Conditions of Helmholz GmbH & Co. KG" apply.

1.8 Open Source

Among other things, our products contain open-source software. This software is subject to the relevant license terms. The relevant license terms, including a copy of the full license text, are downloadable from the product website. They are also provided in our download area of the respective products at www.helmholz.de.

Furthermore, we offer to send the complete corresponding source code of the respective open-source software to you and to any third party as a DVD upon your request for a contribution towards expenses of Euro 10.00. This offer is valid for a period of three years. This offer is valid for a period of three years, calculated from the delivery of the product.

2 Security recommendations

Managed switches are network infrastructure components, and thus an important element in the security considerations of a system or network. When using the device, therefore please consider the following recommendations to prohibit unauthorized access to plants and systems.

General:

- Ensure at regular intervals that all relevant components fulfill these recommendations and possibly any other internal security guidelines.
- Evaluate your system holistically with a view to security. Use a cell protection concepts (“defense-in-depth”) with corresponding products, such as the WALL IE.
- Regularly inform yourself about security threats for all your components

Physical access:

- Limit physical access to components of relevance to security to qualified personnel.

Security of the software:

- Always keep the firmware of all communications components up to date.
- Inform yourself regularly of firmware updates for the product.
- Only activate protocols and functions you really need
- If possible, always use those variants of protocols that provide more security

Passwords:

- Define rules and roles for usage of the devices and the awarding of passwords
- Change standard passwords
- Only use strong passwords. Avoid weak passwords like, for example, “password1”, “123456789”, or similar.
- Ensure that all passwords are inaccessible to unauthorized personnel.
- Don’t use one password for various users and systems.

Helmholz is a member of the CERT@VDE. In addition to our technical newsletter, we communicate our security-relevant updates, patches and advisories to you as a user of Helmholz products. Find out more and use the services and database of the CERT@VDE to make your systems secure and keep them secure.

The Helmholz "**Product Security Incident Response Team**" (PSIRT) supports you proactively to protect your machines as best as possible in the context of industrial communication. Whenever new potential threats occur or are reported to us, we evaluate and process them immediately and provide you with recommended actions, patches and updates as quickly as possible to reduce the risk to a minimum.

You can help too: Report any product incidents to our **Product Security Incident Response Team** at psirt@helmholz.de or support@helmholz.de.

You can find more information on the topic of security here, for example:

- [CERT@VDE](#)
- [Sichere-industrie.de](#)
- [Bundesamt für Sicherheit in der Informationstechnik \(BSI\)](#)
- [Allianz für Cyber-Sicherheit](#)

3 System overview

With the managed FLEXtra PROFINET switches, both PROFINET components with 100 Mbit/s and Ethernet devices with up to 1000 Mbit/s can be networked. This enables communication from the control level and the machine or the mixing of Ethernet and PROFINET components in one switch. PROFINET prioritization of the machine components according to Conformance Class B is always guaranteed.



In addition to PROFINET, functions such as SNMP, NTP, VLAN, port mirroring, QoS/CoS mapping and extensive statistics are available for managing the Ethernet network.

The practical design with the intelligent arrangement of the Ethernet sockets saves space in the control cabinet. The always clearly visible status LEDs on the top of the FLEXtra PROFINET switches enable easy diagnostics even with full cabling.

In addition to up to 16 RJ45 connections, the FLEXtra PROFINET switches also support SFP modules for fiber optic connections.



In addition, the FLEXtra PROFINET switches support the control of ports via inputs and the display of port states via outputs. Bits in the PROFINET-IO image of the switch as well as 4 digital inputs and 2 digital outputs with 24V can be used as inputs and outputs. The assignment and the function of the inputs and outputs can be configured via the GSDML file.



The configuration set via the web interface can be downloaded or saved to an SD card as a backup or for mass commissioning.

One of the most important functions of a PROFINET switch is the prioritization of PROFINET telegram traffic in the machine network. The managed switch can distinguish whether the telegram is a web request, an FTP file transfer, a media stream, or a PROFINET telegram. In the event of a high transmission load, the important telegrams can thus be prioritized to prevent telegram losses of the machine components.

The supported PROFINET protocols, such as LLDP, DCP or even diagnostic alarms, can be easily parameterized and managed.

Technical advantages of using a PROFINET switch:

- -Prioritization of PROFINET telegrams
- -Assignment of a network configuration based on the device name
- -Definition of transmission method and speed of a port
- -Topology detection
- -Device replacement without programming device
- -MRP ring redundancy
- -Each port can be enabled or disabled
- -Diagnostic messages in case of network problems
- -Identification and maintenance data

For the project engineering as a PROFINET device a GSDML file is required.

3.1 Setup

The FLEXtra PROFINET switches are currently available in 3 variants.

- "FLEXtra PROFINET-Switch 16-Port" (700-855-16P01): 16x RJ45 ports with up to 1000MBit/s
- "FLEXtra PROFINET-Switch FO 16-Port" (700-856-12F41): 12x RJ45 ports and 4x SPF ports, all ports up to 1000MBit/s
- "FLEXtra PROFINET Switch FO 10-Port" (700-856-8FO21): 8x RJ45 ports and 2x SPF ports, all ports up to 1000MBit/s



The switch has two concealed function buttons ("RST" and "FCN") as control elements.

The status display at the device is done via four LEDs (PWR, RUN, BF, SF) and additionally LEDs for each Ethernet port.

On the back of the device there is a connector for connecting 4 digital inputs and 2 outputs with 24 V DC.


A micro-SD card slot is accessible above the IO-connector.



The FLEXtra PROFINET switch FO 10-Port (700-856-8FO21) has no EAs and no SD card.

3.2 Taster

The PROFINET switch has two pushbuttons "FCN" and "RST", which are located at the top behind the front panel. The buttons can only be reached with a narrow object (paper clip) to protect against improper usage.

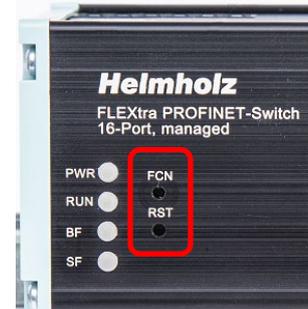

3.2.1 "RST"-Taster (Reset)

The "RST" button triggers an immediate restart of the PROFINET switch. All saved settings are retained.


3.2.2 "FCN"-Taster (Function)

The "FCN" button can be used to reset the PROFINET switch to factory settings. If the "FCN" button is held down during the switch startup phase or after a reset, the green "PWR" and the orange "SF" LEDs light up continuously. This indicates that the switch has loaded the factory setting. After releasing the button, the switch is restarted.

3.3 Status LEDs

The two system LEDs "PWR", "RUN" and the two PROFINET LEDs "BF" and "SF" indicate the system status of the switch.

After switching on or a reset, all 4 LEDs are permanently on for approx. 5 seconds to indicate the start-up process and to check the function of the LEDs.

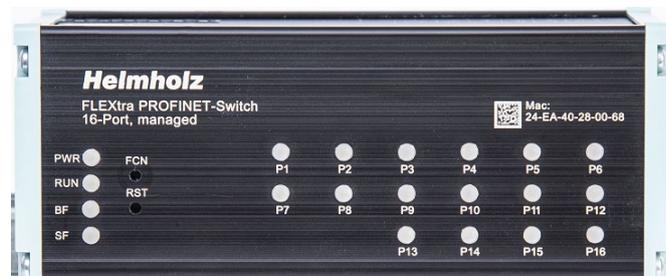

The LEDs P1-P16 indicate the status of the ports.

3.4 System LEDs

PWR	Off	No voltage supply or device defective
	On	Device is correctly supplied with voltage
RUN	Off	Device is defective
	On	Device is ready for operation
	Flashing	Device is booting
	Flashing (together with the BF and SF LED)	PROFINET function device identification ("Flash LED")
BF	On	Bus error or no configuration
	Flashing (together with the BF and SF LED)	PROFINET function device identification ("Flash LED")
SF	On	System error, network state faulty
	Flashing (together with the BF and SF LED)	PROFINET function device identification ("Flash LED")

The **PWR LED** is on as soon as the PROFINET switch is connected to a power supply.

The **RUN LED** is on as soon as the PN switch is ready for operation. The LED flashes during initialization of the PROFINET switch.

The **BF LED** is on as long as there is no PROFINET connection. If there is a PROFINET connection and the PROFINET switch has been configured, the LED is off. The PROFINET switch can only receive a PROFINET configuration if it has been assigned the device name set in the project, see chapter 5.6.

The **SF LED** is on if there is a PROFINET alarm (diagnosis) at the PROFINET switch. If there is no PROFINET alarm, the LED is off.

The **RUN**, **BF** and **SF** LEDs flash synchronously if the user has activated the PROFINET function "Flash LED" for device identification.

3.5 Ethernet LEDs (RJ45 and SFP)

Off		No network cable connected or network cable defective or connected device is off
Green	steady on	Ethernet connection with 10/100 Mbps
	flashes	Ethernet communication with 10/100 Mbps
Orange	steady on	Ethernet connection with 1000 Mbps
	flashes	Ethernet communication with 1000 Mbps

4 Installation and removal

4.1 Access restriction

The modules are open operating equipment and must only be installed in electrical equipment rooms, cabinets, or housings.

Access to the electrical equipment rooms, cabinets, or housings must only be possible using a tool or key, and access should only be granted to trained or authorized personnel.

4.2 Mounting and minimum distances

The FLEXtra PROFINET switches can be mounted on a DIN rail and installed in any position. It is recommended to keep minimum distances when mounting. By keeping the minimum distances

- the modules can be mounted or dismantled without having to dismantle other parts of the system.
- there is enough space to connect all existing connections and contacting possibilities with commercially available accessories.
- There is space for any necessary cable routing.



ATTENTION

Installation must be carried out in accordance with VDE 0100/IEC 364 and applicable national standards. The device has protection level IP20. If a higher degree of protection is required, it must be installed in an enclosure or a control cabinet.

4.3 Electrical installation

Observe the regional safety regulations.

4.4 Protection against electrostatic discharges

To prevent damage through electrostatic discharges, the following safety measures are to be followed during assembly and service work:

- Never place components and modules directly on plastic items (such as polystyrene, PE film) or in their vicinity.
- Before starting work, touch the grounded housing to discharge static electricity.
- Only work with discharged tools.
- Do not touch components and assemblies on contacts.

4.5 EMC protection

To ensure electromagnetic compatibility (EMC) in your control cabinets in electrically harsh environments, the known rules of EMC-compliant configuration are to be observed in the design and construction.



ATTENTION

Observe all standards, regulations and rules regarding shielding when setting up the system and laying the necessary cables. Strictly adhere to the corresponding writings of the PROFIBUS user organization for setting up PROFINET.

Errors in the shielding can lead to malfunctions or even failure of the system.

4.6 Operation

Operate the device only in flawless condition. The permissible operating conditions and performance limits must be adhered to.

Retrofits, changes, or modifications to the device are strictly forbidden.

The device is a piece of operating equipment intended for use in industrial plants. During operation, all covers on the unit and the installation must be closed in order to ensure protection against contact



ATTENTION

When the PROFINET switch is switched off, bus connections are interrupted! Before starting any work on the device, make sure that no impermissible interference occurs in connected systems when the bus connections are interrupted.

4.7 Recycling / WEEE

The company Helmholz GmbH & Co. KG is registered as a manufacturer with the HELMHOLZ brand and the device type "Small devices of information and telecommunications technology for exclusive use in households other than private households" as well as the following registration data:

Helmholz GmbH & Co. KG,
Location / Headquarters: 91091 Großenseebach,
Address: Hannberger Weg 2,
Name of authorized representative: Carsten Bokholt,

Registration number: **DE 44315750**



The electrical devices described in this document are to be recycled. According to Directive 2012/19/EU on waste electrical and electronic equipment (WEEE), they must not be disposed of by municipal waste disposal companies.

5 Preparing the FLEXtra PROFINET-Switch

5.1 Connection

The FLEXtra PROFINET-Switch has a redundant power supply. The FLEXtra PROFINET-Switch must be supplied with 24 VDC via the supplied connector plug on at least one of the two "-/+ " wide range inputs (DC 18 - 30 V).



NOTE

The housing of the FLEXtra PROFINET switch is not grounded. Please connect the functional grounding connection (FG named "FE" on front) of the switch properly to the reference potential.

The RJ45 sockets "X1 P1" - "X1 P16" are used to connect the network nodes (PROFINET or Ethernet).

On the "FLEXtra PROFINET Switch FO 16-Port", the top two rows "X1 P1" - "X1 P12" are designed as RJ45 ports. The ports "X1 P13" - "X1 P16" can be equipped with SFP modules.


On the "FLEXtra PROFINET Switch FO 10-Port", the top two rows "X1 P1" - "X1 P8" are designed as RJ45 ports. The two ports "X1 P9" and "X1 P10" can be equipped with SFP modules.

5.2 Install GSDML file

You can download the GSDML file for the FLEXtra PROFINET switches from the website www.helmholz.de in the download area of the desired product. Alternatively, the GSDML can also be downloaded from the web page of the device ("Status" page).


There is a separate GSDML file for each variant of the FLEXtra PROFINET switches.

Install the GSDML file via the TIA Portal menu "Extras" / "Load device description file (GSD)".

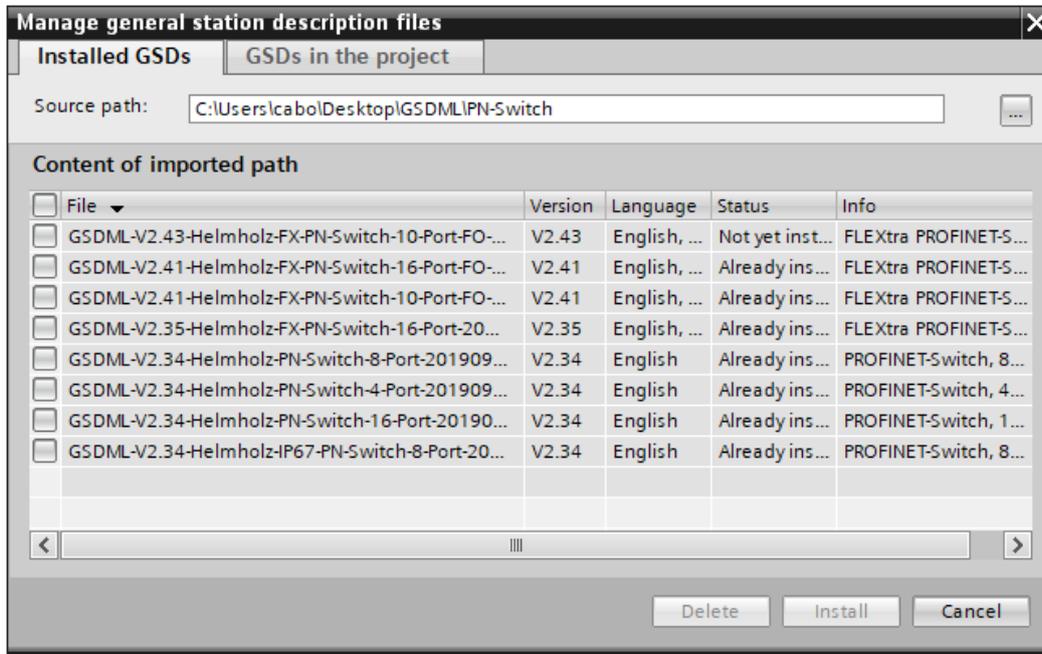

5.3 Setup in the hardware-configuration

After installation, the FLEXtra PROFINET-Switch is listed in the hardware catalog under "Other field devices → PROFINET IO → Network Components → Helmholz GmbH & Co. KG → Helmholz PN-Switch" in the hardware catalog. Add the desired device to the project and connect it to your PROFINET network.

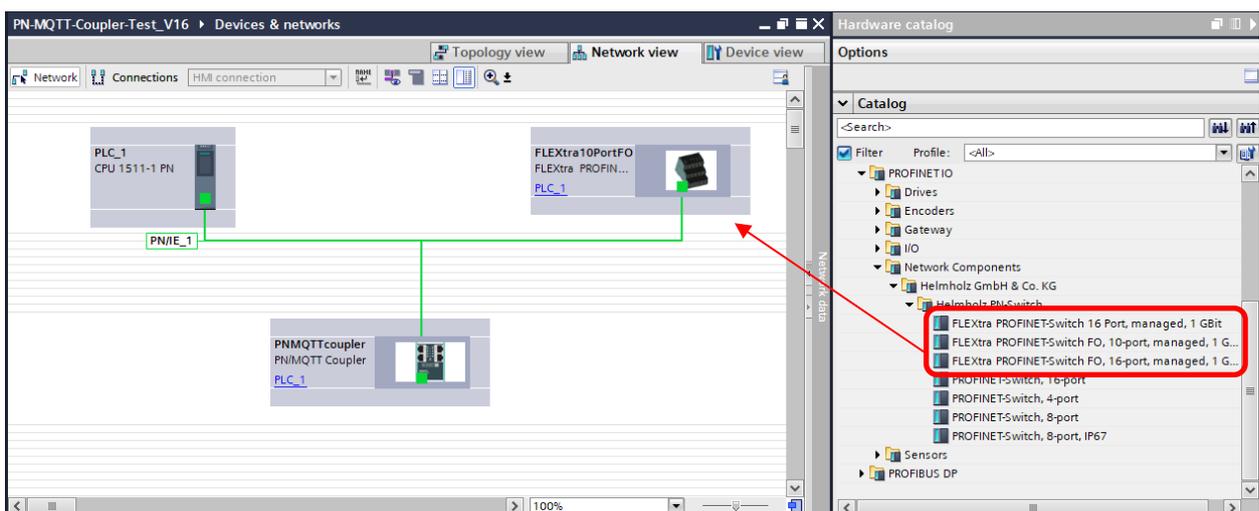


By calling up the object properties, you must give the FLEXtra PROFINET switch a unique PROFINET name in the project and check the IP address for plausibility.




NOTE

The real device must later be assigned the same name as in the project.

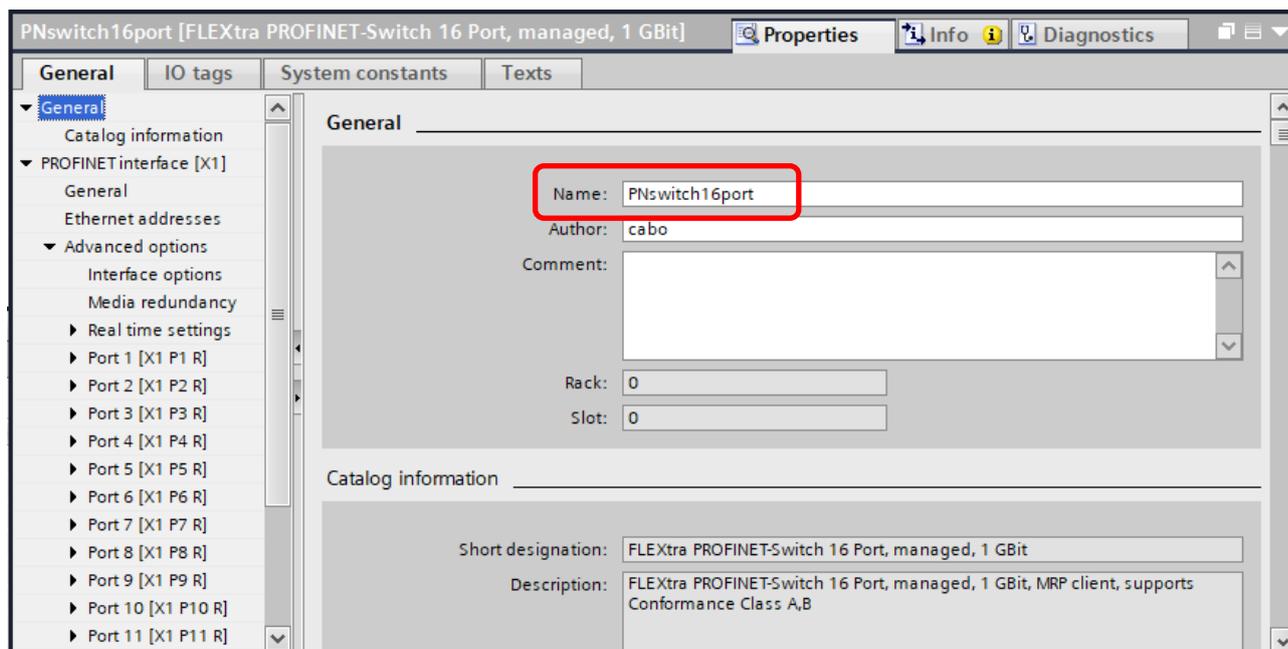

5.4 Setting the port properties

Each port of the PROFINET switch can be individually configured.

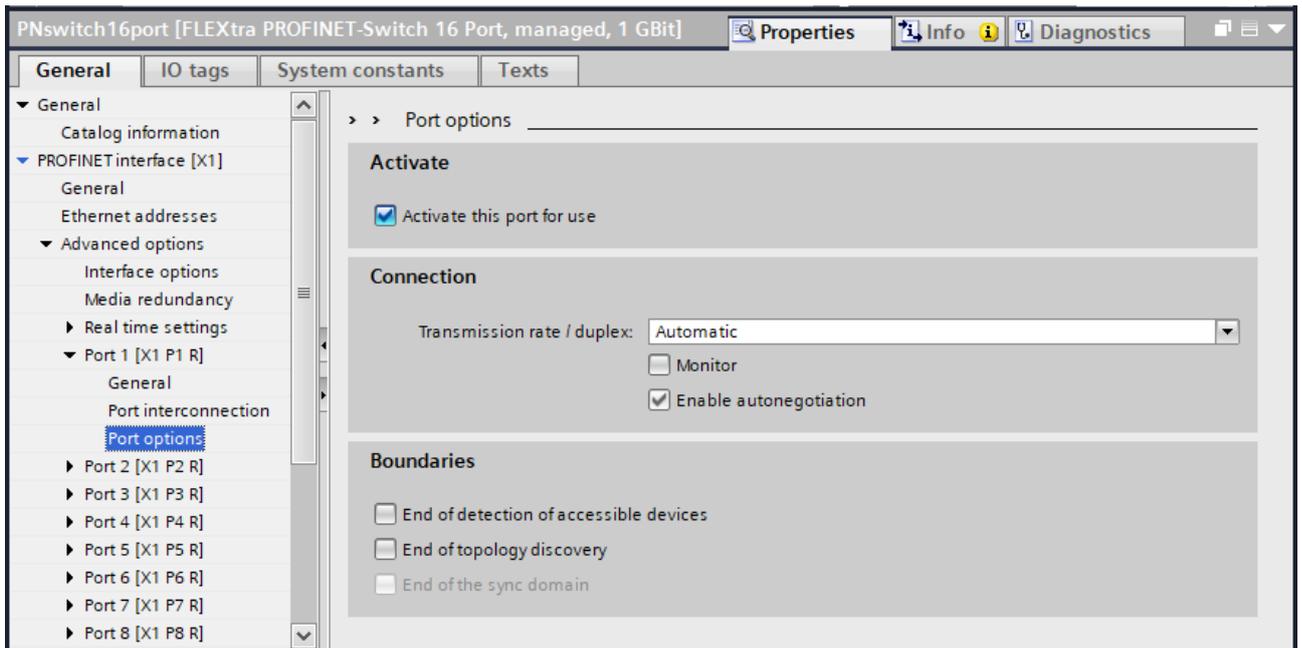

“Activate this port”	The port can be switched off here. This option is recommended when the port should not be used. Unauthorized trespass into the network is prevented.
Transmission rate / duplex “Automatic”	The port synchronizes itself automatically with the communication partner (auto-negotiation).
Transmission rate / duplex “TP 100 Mbps full duplex”	Fixed specification of the transmission rate. This option is recommended when connecting PROFINET IO devices.
Monitor	Send a diagnosis by Link Down
Enable autonegotiation	Automatic recognition of the transmission speed and the cable type (cross or patch cable)
End of detection of accessible devices	The DCP telegrams for recording accessible devices are not forwarded from this port. Subscribers behind this port are no longer displayed under "Accessible subscribers" in the topology. Users behind this port can no longer be reached by the CPU.
End of topology discovery	LLDP frames for topology discovery are not forwarded on this port.


5.5 Use of SFP modules

Up to 4 SFP transceivers ("FLEXtra PROFINET Switch FO 16-Port") or up to 2 SFP transceivers ("FLEXtra PROFINET Switch FO 10-Port") can be plugged into the FLEXtra PROFINET Switch FO.

Each SFP transceiver is a separate port in the switch.

The FLEXtra PROFINET Switch FO has no manufacturer lock-in, i.e. SFP modules from any manufacturer can be used (see below for restrictions).

However, since there are many manufacturers and SFP transceivers on the market, we cannot provide a functional guarantee for all transceivers.

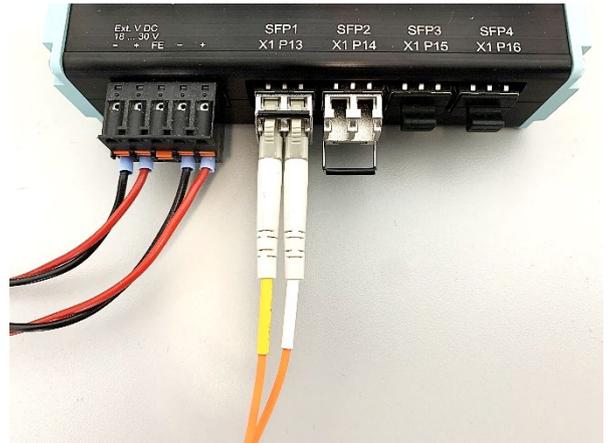

Helmholz offers the following SFP transceiver modules tested with the FLEXtra PROFINET Switch FO:

700-997-1AM01 SFP Transceiver 1000 Mbps, single mode 1310 nm, LC-Anschluss, up to 10 km

700-997-1AN01 SFP Transceiver 1000 Mbps, single mode 1310 nm, LC-Anschluss, up to 40 km

700-998-1AD01 SFP Transceiver 1000 Mbps, multimode 850 nm, LC-Anschluss, up to 500 m

700-998-1AG01 SFP Transceiver 1000 Mbps, multimode 1310 nm, LC-Anschluss, up to 2 km

Please ensure that an SFP transceiver with the same technical data is used on the opposite side of the fiber optic connection.



ATTENTION

Please ensure that an SFP transceiver with the same technical data is used on the opposite side of the fiber optic connection.



NOTE

The FLEXtra PROFINET switch FO currently only supports SFP transceivers with a transmission speed of 1000Mbit/s. The FLEXtra PROFINET switch FO does not support SFP+ transceivers.

To plug in a SFP transceiver, the protective cap on the SFP slot must be removed. Please keep the protective cap in case the SFP transceiver is removed again. The protective cap then prevents dirt from contaminating the empty SFP slot, which could lead to malfunctions.

SFP transceivers can also be plugged in when the FLEXtra PROFINET switch FO is supplied with power and there is operation on the other ports. The switch automatically detects newly inserted SFP modules and puts them into operation.

The port properties correspond to those of the RJ45 ports.



NOTE

Currently, however, only 1000Mbit/s can be used as transmission speed for SFP ports and autonegotiation is not available with FO.

5.6 Setup of SFP modules

The required SFP modules can be preconfigured for SFP ports in the configuration. The Helmholz SFP modules or an entry for any other SFP module ("Gen_SFP_xxx") are available.


Device overview									Catalog
Module	Rack	Slot	I address	Q address	Type	Article no.	Firmware		Search
FLEXtra 16PortFO	0	0	11...27	0...2	FLEXtra PROFINET-Switch FO, ...	700-856-12F41			Filter Profile: <All>
PN40	0	0 X1			FLEXtra 16PortFO				Head module
Port 1	0	0 X1 P1			Port 1				Submodules
Port 2	0	0 X1 P2			Port 2				Gen_SFP_1000Base_LX
Port 3	0	0 X1 P3			Port 3				Gen_SFP_1000Base_SX
Port 4	0	0 X1 P4			Port 4				SFP_MM_LC_2
Port 5	0	0 X1 P5			Port 5				SFP_MM_LC_500
Port 6	0	0 X1 P6			Port 6				SFP_SM_LC_10
Port 7	0	0 X1 P7			Port 7				SFP_SM_LC_40
Port 8	0	0 X1 P8			Port 8				
Port 9	0	0 X1 P9			Port 9				
Port 10	0	0 X1 P10			Port 10				
Port 11	0	0 X1 P11			Port 11				
Port 12	0	0 X1 P12			Port 12				
SFP_MM_LC_500	0	0 X1 P13			SFP_MM_LC_500	700-998-1AD01			
SFP_SM_LC_10	0	0 X1 P14			SFP_SM_LC_10	700-997-1AM01			
Gen_SFP_1000Base_LX	0	0 X1 P15			Gen_SFP_1000Base_LX				
	0	1 P16							

If the Helmholz SFP modules are configured, the FLEXtra PROFINET switch checks whether exactly the configured SFP module has been plugged into the specified port.

If an SFP module is missing or an SFP module of a different type is plugged, a diagnosis is triggered. Thus a wrong configuration or a wrong cabling can be detected easily.

5.7 Topology detection

The PROFINET-Switch supports the mechanisms for neighbor detection (LLDP). With this function it is possible to detect the topology of a PROFINET network or to predefine it by the configuration to control the correct setup.

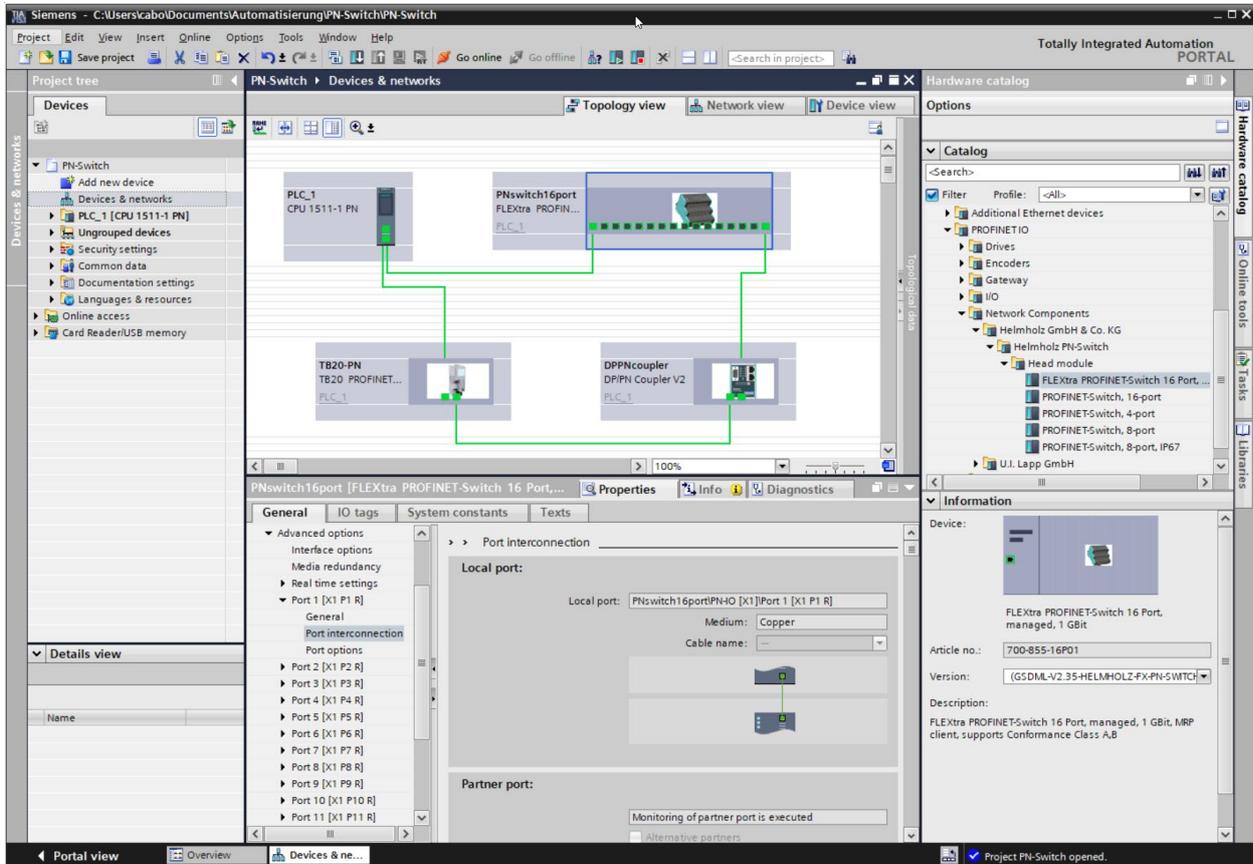


If the topology was specified in the configuration, the PROFINET name can also be assigned to neighboring devices in the event of a device swap. This makes it possible to detect and check the network topology and to "swap devices during operation" of connected PROFINET devices.

5.8 Assign the PROFINET switch a name

When the configuration of the FLEXtra PROFINET-Switch has been completed in the hardware configurator of the engineering tool, it can be loaded into the PLC.

In order that the FLEXtra PROFINET-Switch can be found by the PROFINET controller, the PROFINET device name must be assigned to the PROFINET-Switch. To this purpose, use the function “Assign device name”, which you can access in the Online menu with the right mouse button when the PROFINET-Switch is activated.

With the “Update list” button, the network can be browsed for PROFINET participants. The PROFINET device name can be assigned to the device with “Assign name”.

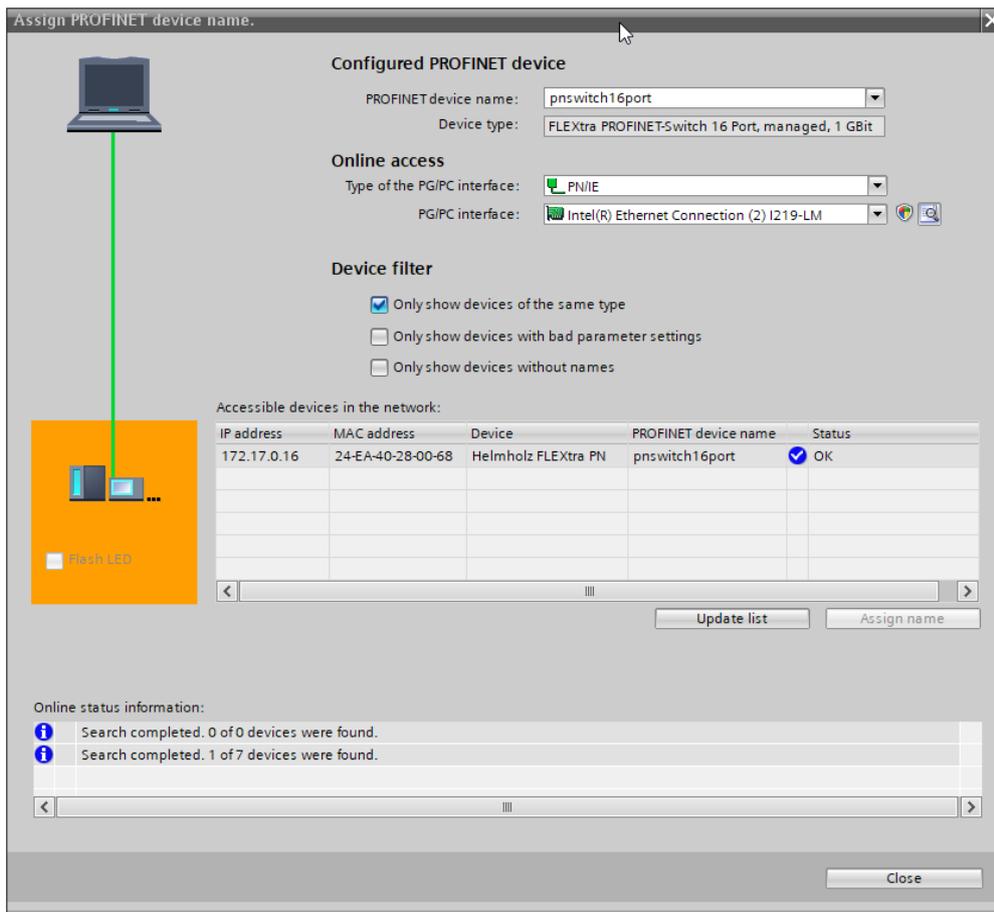

The clear identification of the FLEXtra PROFINET switch is ensured here by the MAC address of the device. The MAC address of the device can be found on the device front of the FLEXtra PROFINET switch.

If the PROFINET switch has been assigned the correct PROFINET name, it is recognized by the PLC and configured. If configuration has taken place correctly, the PROFINET “BF” LED is off.

The Helmholz IPSet tool, which can be downloaded at no charge from the Helmholz website, can also be used to set the PROFINET name. Scan the following QR code to download the IPSet tool:



5.9 Media redundancy protocol (MRP)

The PROFINET switch optionally supports media redundancy (MRP) as a MRP client. MRP enables ring cabling, which allows the PROFINET network to operate even if a cable or a device fails.

In a MRP ring there must be a MRP manager (e.g. the PLC), all other participants of the ring are then MRP clients.

To assign the PROFINET switch to an MRP ring, the media redundancy role "Client" must be set under "Properties"/"General" for the "Media redundancy" option.

The screenshot displays the SIMATIC Manager interface. The top window shows a 'Topology view' of a network with four main components: 'PLC_1 CPU 1511-1 PN', 'PNswitch16port FLEXtra PROFIN...', 'TB20-PN TB20 PROFINET...', and 'DPPNcoupler DP/PN Coupler V2'. Green lines represent network connections between these devices. Below the topology, the 'Properties' window for 'PNswitch16port [FLEXtra PROFINET-Switch 16 Port,...]' is open, showing the 'Media redundancy' configuration. The 'Media redundancy role' is set to 'Client', and the 'MRP domain' is 'mrpdomain-1'. The 'Ring port 1' and 'Ring port 2' are also configured. A 'Diagnostics interrupts' checkbox is checked. A 'Domain settings' button is visible at the bottom of the configuration panel.



NOTE

If a ring cabling is established without the MRP roles being configured on all devices involved, the PROFINET network may malfunction!


6 Configuration and diagnostics via the web interface

6.1 Login

Via the web interface, the status of the PROFINET switch can be queried and further functions can be configured. Furthermore, a firmware update can be performed via the web interface.


The web interface can be operated as soon as the device has a network configuration. The IP address of the device must be entered as URL.

In the following login dialog, the username is "admin" and the password is the serial number of the FLEXtra PROFINET switch, which can be read on the side of the device. When logging in for the first time, the default password must be changed.

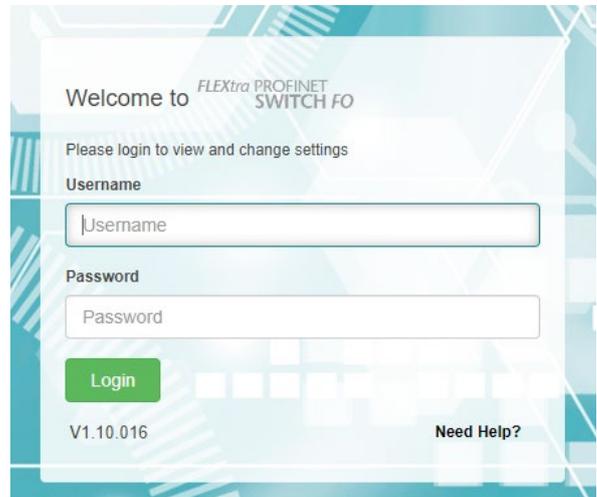

6.2 "System" menu

The "System" menu contains basic functions for operating the FLEXtra PROFINET switch.

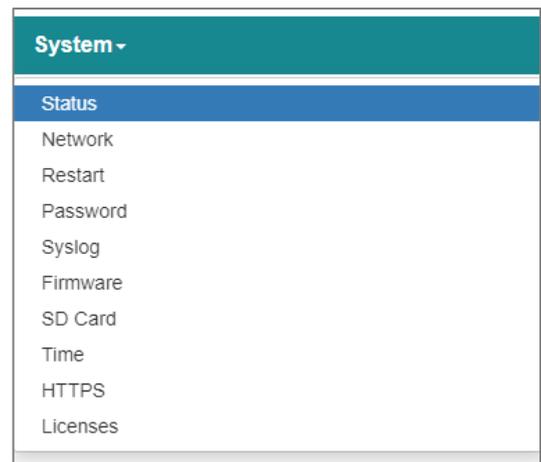

6.2.1 Status

The "System / Status" web page is the start page of the PROFINET switch, it shows the basic system status and information about the switch. This includes the status of all ports, the device type, the MAC address, the firmware version, the system time and the status of the external and internal IOs and the SD card.

System Status | Logout | Help

FLEXtra PROFINET SWITCH **Helmholz**
COMPATIBLE WITH YOU

System - Agent - Switch - Statistics -

Port Status Overview Show all Hide all

Port 1	Port 2	Port 3	Port 4
Port 5	Port 6	Port 7	Port 8
Port 9	Port 10	Port 11	Port 12
Port 13	Port 14	Port 15	Port 16

System Status

Device Type	Helmholz FX PN-Switch	Digital I/O Pin Status	IO1 ● IO2 ● IN3 ● IN4 ●																																			
Device MAC	24-EA-40-28-02-BB	Power Supply Status	PS1 ● PS2 ●																																			
Protocol Status	Connected	Diagnostic Status	No diagnostic present																																			
System Failure	No	SD Card Status	No SD Card mounted																																			
System Time	01/01/2000 07:33:50	Input Bytes	<table border="1"> <tr> <th>Byte</th> <td>16</td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <th>Value</th> <td>00</td><td>00</td><td>00</td><td>00</td><td>00</td><td>00</td><td>00</td><td>00</td><td>02</td><td>82</td><td>00</td><td>00</td><td>00</td><td>82</td><td>03</td><td>B0</td> </tr> </table>	Byte	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	Value	00	00	00	00	00	00	00	00	02	82	00	00	00	82	03	B0
Byte	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																					
Value	00	00	00	00	00	00	00	00	02	82	00	00	00	82	03	B0																						
System Up Time	0 days 0:01:34	Output Bytes	<table border="1"> <tr> <th>Byte</th> <td>2</td><td>1</td><td>0</td> </tr> <tr> <th>Value</th> <td>00</td><td>00</td><td>00</td> </tr> </table>	Byte	2	1	0	Value	00	00	00																											
Byte	2	1	0																																			
Value	00	00	00																																			
Firmware Version	V1.06.004																																					

The ports of the port status display can be opened by clicking on them to get more information about each port.

Port Status Overview Show all Hide all

Port 1	Port 2	Port 3	Port 4
<p>Status: Link up, 1000 Mbps</p> <p>Peer/s: 1 Peer Connected</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.00%, Tx 0.00%</p> <p>Error packets: -</p> <p>More info: 1000 Mbps</p>	<p>Status: Link up, 100 Mbps</p> <p>Peer/s: 1 Peer Connected</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.04%, Tx 0.05%</p> <p>Error packets: -</p> <p>More info:</p>	<p>Status: Link down, -</p> <p>Last peer/s:</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.00%, Tx 0.00%</p> <p>Error packets: -</p> <p>More info:</p>	<p>Status: Link down, -</p> <p>Last peer/s:</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.00%, Tx 0.00%</p> <p>Error packets: -</p> <p>More info:</p>

By clicking on "Peer Connected" or "VLAN: Show Info" more information about the port can be retrieved.

Port Status Overview Show all Hide all

Port 1	Port 2	Port 3	Port 4
<p>Status: Link up, 1000 Mbps</p> <p>Peer/s: 1 Peer Connected</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.00%, Tx 0.00%</p> <p>Error packets: -</p> <p>More info: 1000 Mbps</p>	<p>Status: Link up, 100 Mbps</p> <p>Peer/s: 1 Peer Connected</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.04%, Tx 0.05%</p> <p>Error packets: -</p> <p>More info:</p>	<p>Status: Link down, -</p> <p>Last peer/s:</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.00%, Tx 0.00%</p> <p>Error packets: -</p> <p>More info:</p>	<p>Status: Link down, -</p> <p>Last peer/s:</p> <p>VLAN: Show Info</p> <p>Netload: Rx 0.00%, Tx 0.00%</p> <p>Error packets: -</p> <p>More info:</p>

Pop-up for Port 1 Peer/s: 1 Peer Connected:

#	MAC	IP	Name
1	4C:52:62:0C:5D:20	0.0.0.0	pc276

Pop-up for Port 2 Peer/s: 1 Peer Connected:

#	MAC	IP	Name
1	24:EA:40:1B:00:7C	172.17.0.82	PN/MQTT Coupler 700-162-3M002 50063863 2 V 1 6 0

In the "Switch/SFP Status" menu, the information read out by the switch from the SFP transceiver can be viewed.

SFP Module Information

Port 13 - Module Plugged, Information Available

Vendor Name	HELMHOLZ	Temperature [°C]	40.312
Part Number	700-998-1AD01	Voltage [V]	3.326
Revision	HW1	Tx Bias [mA]	4.208
Serial Number	CF0060UC100025	Tx Power [mW]	0.212
Transceiver Type	1000 BASE-SX	Tx Power [dBm]	-6.74
Transceiver Identifier	SFP/SFP+/SFP28 and later	Rx Power [mW]	0.221
Connector Type	LC (Lucent Connector)	Rx Power [dBm]	-6.56
Signaling Rate [Mbit/s]	1300		
Max Link Length (50 um)[m]	550		
Max Link Length (62.5 um)[m]	270		

6.2.2 Network configuration

The network configuration consists of IP address, subnet mask, default gateway and the PROFINET device name. IP address and subnet mask together define the address of the network. The standard gateway is required for the transition to other networks.

The PROFINET switch can be operated in two modes.

1. configured via PROFINET
2. managed switch without PROFINET

In the PROFINET configuration operating mode, the switch must be assigned a PROFINET name and then it receives its IP address, subnet mask and default gateway from the PROFINET controller's configuration when the PLC starts up.

The PROFINET device name can be set via the PROFINET configuration tool or via the Helmholtz IPSet tool (see Chap. 5.6).



NOTE

If the PROFINET switch has been configured via PROFINET, no changes to the network parameters are possible.

In the "Managed Switch" operating mode, the IP address can be set via the "IPSet" tool in order to be able to access the web page for further configuration.

#	Gerät	Name	IP	MAC	
1	PN/MQTT Coupler	pnmqttcoupler	172.17.0.82	24:ea:40:1b:00:20	Anzeigen
2	Helmholtz FX PN-Switch		172.17.0.16	24:ea:40:28:01:45	Anzeigen
3	S7-1500	plcxb1d0ed	172.17.0.80	28:63:36:c4:9f:d9	Anzeigen

The network configuration can be displayed under "Network" (in the "System" menu) and changed in the "Managed Switch" operating mode.

The screenshot shows a web interface titled "System" with a sub-menu "Network Parameters". It contains four input fields: "IP Address" with the value "172.17.0.16", "Subnet Mask" with "255.255.255.0", "Default Gateway" with "0.0.0.0", and an empty "Device Name" field. At the bottom, there are two buttons: a green "Submit" button with a checkmark and a red "Decline" button with an 'X'.

6.2.3 Restart and Factory Reset

The device can be restarted and reset to factory settings via the web interface. Both functions are available in the web interface under "Restart" ("System" menu).

The screenshot shows a web interface titled "System" with a sub-menu "Reset Operations". It has two radio buttons: "Restart" (selected) and "Factory Reset". Below them is a warning message: "Factory reset will reset all configuration settings to their default values! Access to the webserver will only be possible after assigning an IP address." At the bottom, there is a green "Submit" button with a checkmark.

The restart of the device can also be triggered at any time also by pressing the "RST" button on the front panel of the device.

To reset the device to factory settings with the "FCN" button, the following steps are necessary:

1. Switch on or restart the device, pressing and holding the FCN button.
2. Wait until the "SF" LED lights up.
3. Release the "FCN" button.

6.2.4 Password

Access for the administrator to the web interface is protected by a password. The password must be changed after startup. The factory preset password cannot be assigned again. Passwords can be between 4 and 20 ASCII characters long.

The password can be changed under "Password" ("System" menu):

The screenshot shows a web interface titled "System" with a sub-menu "Admin Password". It contains two input fields: "New Password" and "Repeat Password". At the bottom, there are two buttons: a green "Submit" button with a checkmark and a red "Decline" button with an 'X'.

6.2.5 Event Logging

System events are stored in the device and can be retrieved even after the device has been restarted. System events consist of:

- Current entry number since restart
- Time (relative to the system restart or real time)
- Text describing the system event.

System events can be viewed and deleted under "Event Log" ("System" menu).

System ▾		Agent ▾		Switch ▾	
<h3>Log</h3>					
✕ Clear					
Log-Nr.	Restart	Uptime/Time	Event Text		
399	96	2019/05/15 15:20:00	System time set to 2019.05.15-15:20:00		
398	96	2019/05/15 14:54:40	Device name: "test-device"		
397	96	2019/05/15 14:13:59	port 2: link goes up: 100 FD		

6.2.6 Firmware Upgrade

The firmware stored in the device can be updated. New firmware versions are delivered in files with the extension ".huf" and are available via the Helmholtz homepage www.helmholz.de.

Under "Firmware" ("System" menu), a firmware file can be selected and loaded into the device. After loading, a restart is performed.



System ▾		Agent ▾	
<h3>Firmware Upgrade</h3>			
🔍 Browse	Upload firmware (*.huf)		
✓ Submit			
<small>Currently installed firmware version is V1.10.000</small>			




ATTENTION

Interrupting the power supply during the update process can render the device unusable. The device must then be sent in for repair.

6.2.7 Saving and restoring a configuration

The FLEXtra PROFINET-Switch has a slot for a micro-SD card on the back above the IO port. The micro-SD card can be used to save and load configurations. All current settings can always be saved to the card or read. Several configurations can be stored on the micro-SD card.

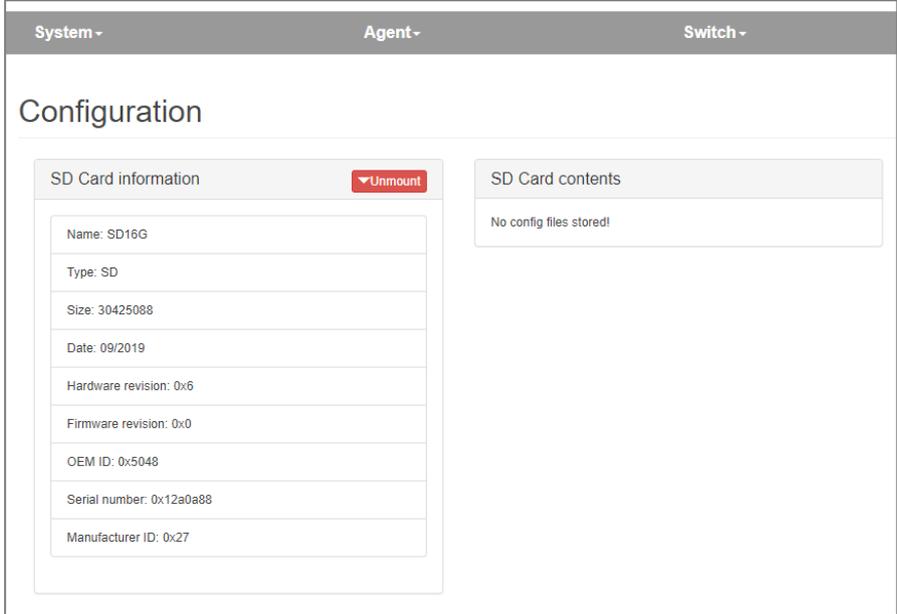

NOTE

The micro-SD card should be formatted in FAT32 and currently has a maximum size of 32 GB.


6.2.8 Time Settings

The time of the FLEXtra PROFINET-Switch can be set. The time is used for the display of system events. The time can be set manually or synchronized with a time server (SNTP).


The configuration of the time can be displayed and changed under "Time" ("System" menu). Depending on the selected synchronization mode, the web page is displayed differently.

If manual synchronization was selected, a form appears with which the current system time can be displayed and changed.

If "SNTP" is selected as synchronization, the form appears to be able to configure the SNTP server.

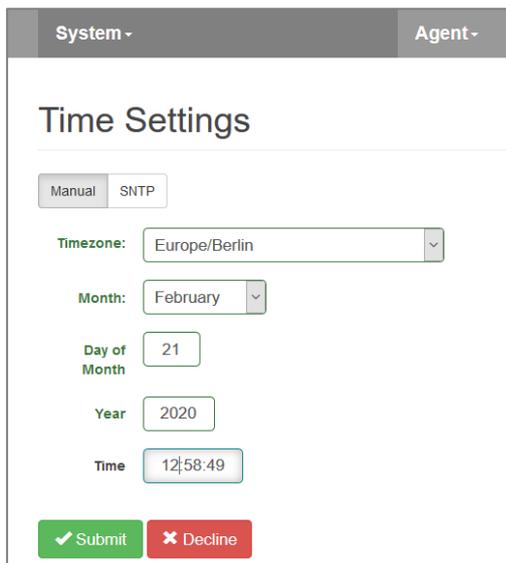

The screenshot shows the "Time Settings" page with the "Manual" tab selected. The form includes a "Timezone" dropdown menu set to "Europe/Berlin", a "Month" dropdown menu set to "February", a "Day of Month" input field with "21", a "Year" input field with "2020", and a "Time" input field with "12:58:49". At the bottom, there are two buttons: a green "Submit" button with a checkmark and a red "Decline" button with an 'X'.

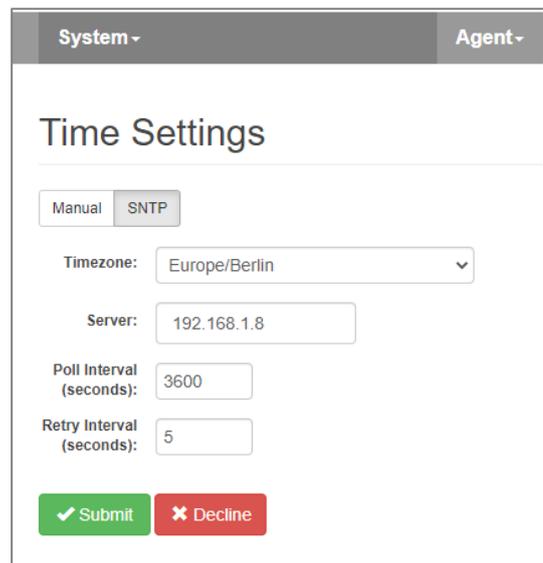


The screenshot shows the "Time Settings" page with the "SNTP" tab selected. The form includes a "Timezone" dropdown menu set to "Europe/Berlin", a "Server" input field with "192.168.1.8", a "Poll Interval (seconds)" input field with "3600", and a "Retry Interval (seconds)" input field with "5". At the bottom, there are two buttons: a green "Submit" button with a checkmark and a red "Decline" button with an 'X'.

6.2.9 Certificates for website

To further secure the SSL-encrypted access to the website, it is possible to store a certificate for the device. The HTTPS access is then not only encrypted, but also with a secure authentication of the website.

The certificate and private key for the website can be stored in the "HTTPS" menu.

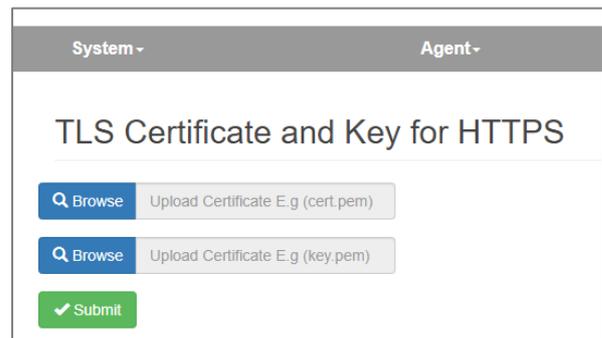

The screenshot shows the "TLS Certificate and Key for HTTPS" page. It features two "Browse" buttons with search icons, each followed by a text input field containing "Upload Certificate E.g (cert.pem)" and "Upload Certificate E.g (key.pem)" respectively. At the bottom, there is a green "Submit" button with a checkmark.


6.3 „Agent“ menu

6.3.1 Web

The form for viewing and changing the settings for Ethernet-based administration is located under "Web" in the "Agent" menu.

If "System status Without Login" is enabled, the system status is displayed on the login page so that the device status can be checked without logging in.

Web Session Timeout (minutes): Defines the timeout for automatic user logout due to inactivity. Valid entry is 0 - 60, where 0 disables timeout monitoring.

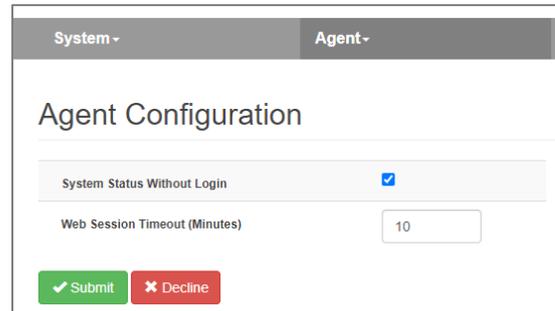


The screenshot shows the 'Agent Configuration' page. At the top, there are two tabs: 'System' and 'Agent'. The 'Agent' tab is selected. Below the tabs, the page title is 'Agent Configuration'. There are two main settings: 'System Status Without Login' which is checked with a blue checkbox, and 'Web Session Timeout (Minutes)' which is set to '10' in a text input field. At the bottom, there are two buttons: a green 'Submit' button with a checkmark icon and a red 'Decline' button with an 'x' icon.

6.3.2 Identification & Maintenance

The information on identification and maintenance (I&M0) includes the PROFINET vendor ID, order number, serial number and information on the hardware and firmware version. The user settings for I&M1 to I&M3 are also displayed here.

The information is displayed under "I&M" in the "Agent" menu.

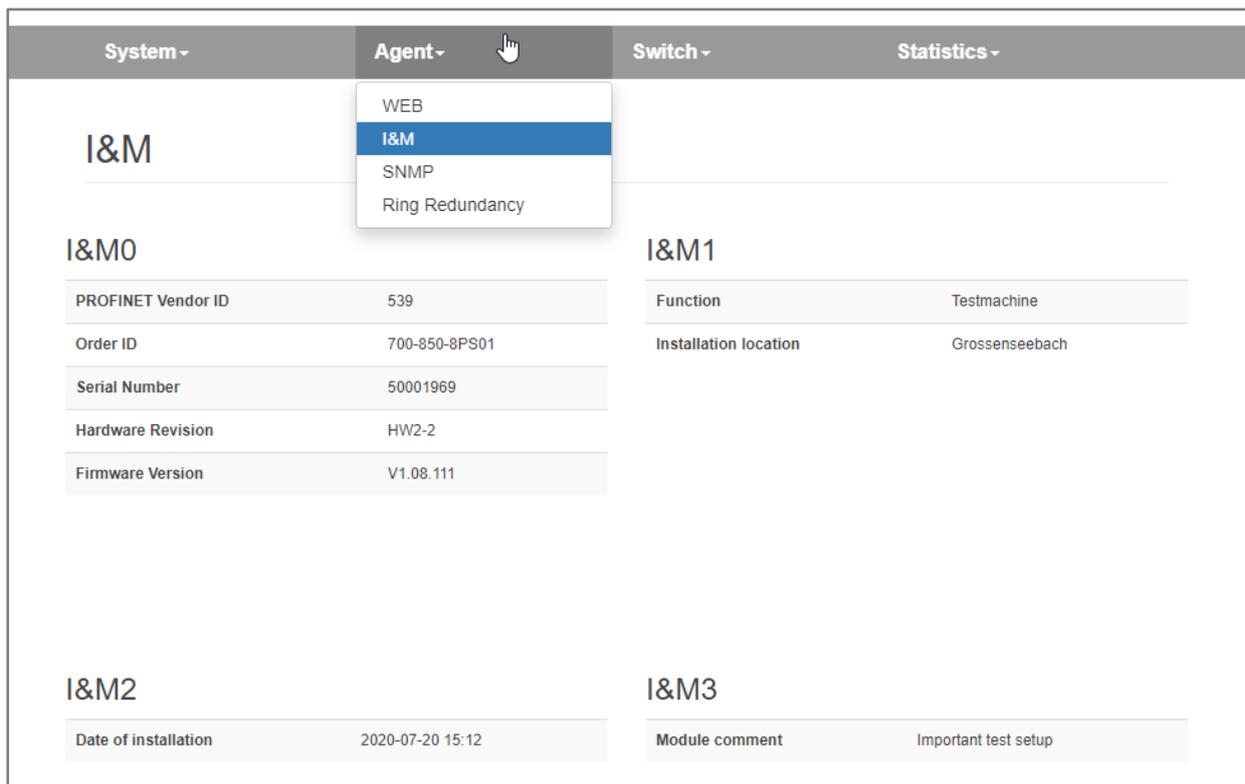

The screenshot shows the 'Agent' menu with a dropdown menu open. The dropdown menu has four options: 'WEB', 'I&M' (highlighted in blue), 'SNMP', and 'Ring Redundancy'. The main content area is titled 'I&M' and is divided into four sections: I&M0, I&M1, I&M2, and I&M3.

I&M0	
PROFINET Vendor ID	539
Order ID	700-850-8PS01
Serial Number	50001969
Hardware Revision	HW2-2
Firmware Version	V1.08.111

I&M1	
Function	Testmachine
Installation location	Grossenseebach

I&M2	
Date of installation	2020-07-20 15:12

I&M3	
Module comment	Important test setup

6.3.3 PROFINET Scan

The "PN Scan" function in the "Agent" menu can be used to perform a scan of the network for PROFINET nodes. All devices found are displayed with type, name, current IP address, MAC address. In addition, the port of the FLEXtra PROFINET switch at which the device was found is displayed.

The screenshot shows the 'Agent' menu with 'PN Scan' selected. Below the menu is a 'NOTE' section and a table of discovered devices. A 'Start Scan' button is visible at the bottom.

#	Device	Name	IP	MAC	Port
1	PN/MQTT Coupler	pnmqttcoupler	172.17.0.82	24:ea:40:1b:00:7c	2
2	SCALANCE XC-200	xc208	172.17.0.91	20:87:56:a4:e2:ec	1
3	S7-1500	plcxb1.profinetxainterfacexb1036c	172.17.0.80	28:63:36:c4:9f:d9	5
4	SIMATIC-PC	pc293	172.17.0.2	f4:f2:6d:02:26:04	1
5	S7-300	dp-cpu	172.17.0.200	28:63:36:21:2e:0c	1

6.3.4 SNMP V2/V3

SNMP (Simple Network Management Protocol) is an IP-based protocol for monitoring and controlling network components.

The FLEXtra switches support SNMP V2 by default. SNMP V3 can be activated if required.

For security reasons, SNMP can also be completely disabled (SNMP version "Off").

The screenshot shows the 'SNMP Settings' page. At the top, there are two tabs: 'System' and 'Agent'. The 'Agent' tab is active, and a dropdown menu is open, showing options: WEB, I&M, PN Scan, **SNMP** (highlighted), and Ring Redundancy. The main content area is titled 'SNMP Settings' and is divided into three sections:

- SNMP Version:** Three radio buttons are present: 'Off', 'SNMPv2' (selected), and 'SNMPv3'. A green 'Submit' button is below them.
- System Description:** Three input fields: 'System Contact' (Helmholz GmbH & Co. KG), 'System Name' (FLEXtra PN-Switch), and 'System Location' (Demo rack 1). Below these are two buttons: a green 'Submit' and a red 'Decline'.
- SNMPv3 Settings:** A table with columns: Name, Permission, Security Level, Auth. Password, Enc. Password, and Access Control. The first row shows: Name (empty), Permission (Read only), Security Level (None), Auth. Password (Auth. password), Enc. Password (Enc. password), and Access Control (.1). A green '+' button is at the end of the row.

Below the table is an 'Available Users' section with a table for user management. The table has columns: Name, Permission, Authentication, and Access control. The first row shows a checkbox for 'All' (checked), followed by empty cells for Name, Permission, Authentication, and Access control.

The following SNMP attributes can be displayed and changed:

- System Contact
(SNMP-OID: 1.3.6.1.2.1.1.4)
- System Name
(SNMP-OID: 1.3.6.1.2.1.1.5)
- System Location
(SNMP-OID: 1.3.6.1.2.1.1.6)

The attributes can be displayed and changed under "SNMP" (menu "Agent").

The FLEXtra PROFINET switch currently only supports SNMP V2.

For **SNMP V3** applications, users can be created in the switch.


Security Level for SNMP V3: The user can choose between the options "None" (no additional verification), "Auth. Only" (only authentication) and "Enc. & Auth." (encryption and authentication).

The SHA protocol is used for authentication, the AES protocol for encryption.

6.3.5 Topology („Ring Redundancy“)

The PROFINET switch can be used in a ring topology as MRP client. Changes to the topology settings can only be made in the PROFINET hardware configuration.

The current topology settings can be viewed under "Ring Redundancy" in the "Agent" menu.

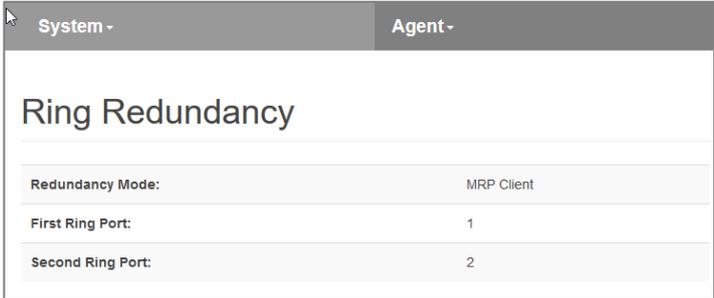

Ring Redundancy	
Redundancy Mode:	MRP Client
First Ring Port:	1
Second Ring Port:	2

6.4 „Switch“ menu

6.4.1 Port Status

The current status and settings of the Ethernet ports can be queried and changed.

The form for displaying the port status and changing the port settings is located under "Port Status" in the "Switch" menu.

A port can be switched on or off, i.e. deactivated.

A port can operate with auto-negotiation ("auto"), with 100 Mbps/full duplex ("100MB/FD") or with 1000 Mbps/full duplex ("1000MB/FD").

With the "Autoneg" setting, the establishment of the ethernet connection is preceded by a procedure in which MDI-X is enabled and the partners jointly agree on a speed/duplex.

Port	Status	Speed	Phys. Status	Link
Port 1	Enabled	Autoneg	100 MB/FD	up
Port 2	Enabled	Autoneg		down
Port 3	Enabled	Autoneg		down
Port 4	Enabled	Autoneg	100 MB/FD	up
Port 5	Enabled	Autoneg	100 MB/FD	up
Port 6	Enabled	Autoneg		down
Port 7	Enabled	Autoneg		down
Port 8	Enabled	Autoneg		down



NOTE

Changes to the port settings are only possible if no PROFINET configuration is active in the switch.

6.4.2 Port Mirroring

The Ethernet ports of the PROFINET switch can be set up to mirror the incoming and outgoing data traffic of another port. A maximum of one port can be set up as a mirror of another. The port remains usable for its own data traffic without any restrictions.

The form for viewing and changing port mirroring is located under "Switch / Port Mirroring".

Port Mirroring

Mirroring Enabled


Mirrored Port 2

Monitor Port 4

6.4.3 ARP-Table

The IP addresses known to the PROFINET switch and their associated MAC addresses can be queried. The query only considers IP addresses of devices with which the PROFINET switch communicates via IP.

The query ARP table can be found at "ARP Table" (section Switch).

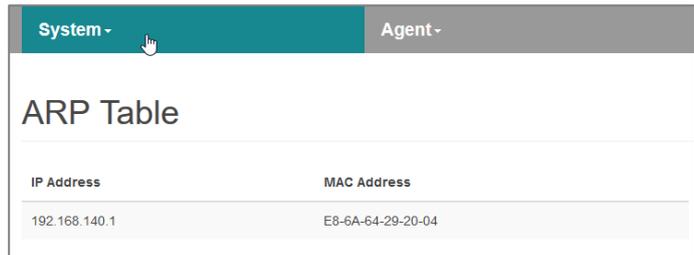

IP Address	MAC Address
192.168.140.1	E8-6A-64-29-20-04

6.4.4 LLDP

PROFINET devices periodically send so-called LLDP frames to the devices to which they are connected via Ethernet. In this way, PROFINET devices receive information about exactly who they are connected to. This information is retained and forms the basis for determining the network topology.

If the connected device is not a PROFINET device, sending the LLDP frames and holding the corresponding information can lead to problems when detecting the network topology. Therefore this function can be disabled for each port.

For the LLDP frames, each port has its own MAC address. Example for the first ports of the PROFINET-Switch:


Device: 24-EA-40-20-xx-xx

Port 1: 24-EA-40-21-xx-xx

Port 2: 24-EA-40-22-xx-xx

Port 3: 24-EA-40-23-xx-xx

...

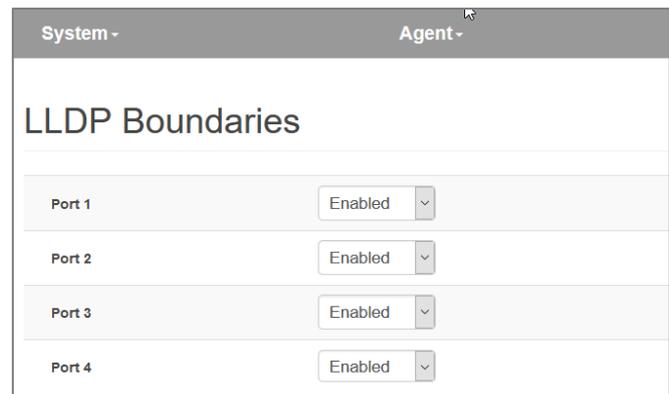

Port	LLDP Boundaries
Port 1	Enabled
Port 2	Enabled
Port 3	Enabled
Port 4	Enabled

The form for querying and changing the LLDP settings is located under "LLDP" in the "Switch" menu.



NOTE

Changes to the LLDP settings are only possible on the web page as long as no PROFINET configuration is active in the switch. With a PROFINET configuration, this function can be set via the port configuration in the PROFINET tool.

6.4.5 DCP boundaries

The DCP protocol can be used to detect PROFINET devices in a network and provide them with basic parameters such as IP address and device name. For this purpose, DCP frames are forwarded to all ports.

If forwarding to a particular port is undesirable, it can be disabled. The reception of DCP frames on this port is unaffected.

The form for querying and changing the DCP settings is located under "DCP" in the "Switch" menu.

DCP Boundaries

Port 1	Enabled	▼
Port 2	Enabled	▼
Port 3	Enabled	▼
Port 4	Enabled	▼



NOTE

Changes to the DCP settings are only possible on the web page as long as no PROFINET configuration is active in the switch. With a PROFINET configuration, this function can be set via the port configuration in the PROFINET tool.

6.4.6 Preferential forwarding of time-critical data („CoS“)

Time critical PROFINET data are sent as Ethernet frames with IEEE 802.1q header. In this header there is IEEE 801.2p data, which contains a priority specification (PCP).

The following PCP values are in use with PROFINET:

Frame	PCP-Value (0 ... 7)
PROFINET alarms	5
Cyclic IO data	6
MRP-Frames	7

The PROFINET switch can use this priority specification for preferred forwarding. This is particularly important when larger data volumes that are less time-critical sometimes pass through the switch. The configuration allows the priority specifications to be assigned to four queues. The queues are numbered 0 through 3 with 0 being the lowest priority and 3 being the highest priority. Ethernet frames without IEEE 802.1q headers are assigned to queue 0.

The form for viewing and changing the queue assignment is located under "CoS" in the "Switch" menu.

PCP	Queue	Traffic Type
0	0	Background
1	1	Best Effort
2	2	Excellent Effort
3	3	Critical Applications
4	4	Video
5	5	Voice, PROFINET-Alarms
6	6	Internetwork Control, Cyclic IO-Data
7	7	Network Control, MRP-Frames



NOTE


The factory default setting ensures preferential forwarding of time critical PROFINET data ("Cyclic IO Data") and PROFINET alarms.

6.4.7 Port Forwarding rules („MAC Table“)

Ethernet frames are forwarded on the basis of forwarding rules. Such a rule consists of a MAC address and the ports to which frames with this destination address are forwarded. The currently valid forwarding rules can be queried.

In addition to the four external ports, the forwarding to the internal interface of the PROFINET switch ("C") is also shown.

The form for querying the forwarding rules is located under "MAC Table" in the "Switch" menu.

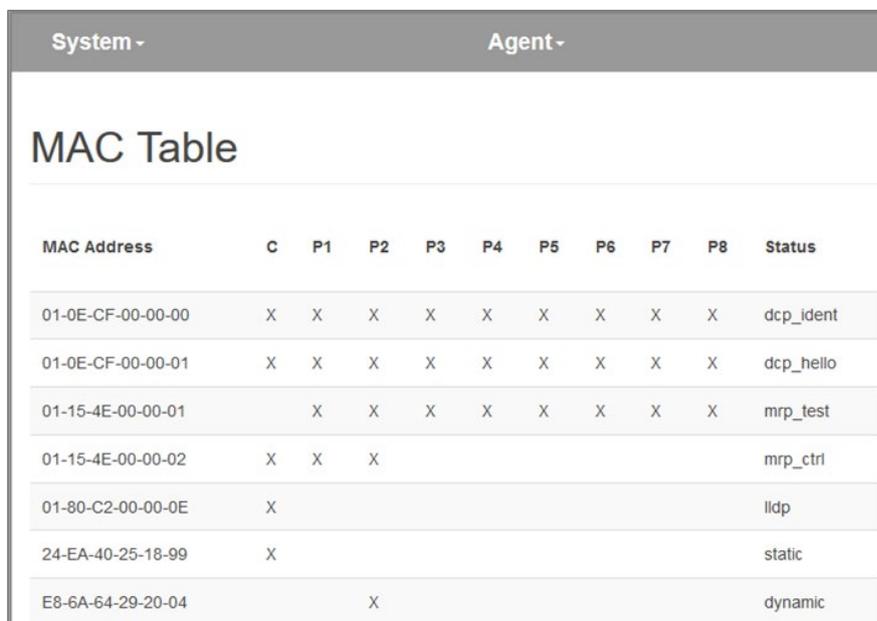

MAC Address	C	P1	P2	P3	P4	P5	P6	P7	P8	Status
01-0E-CF-00-00-00	X	X	X	X	X	X	X	X	X	dcp_ident
01-0E-CF-00-00-01	X	X	X	X	X	X	X	X	X	dcp_hello
01-15-4E-00-00-01		X	X	X	X	X	X	X	X	mrp_test
01-15-4E-00-00-02	X	X	X							mrp_ctrl
01-80-C2-00-00-0E	X									lldp
24-EA-40-25-18-99	X									static
E8-6A-64-29-20-04			X							dynamic

6.4.8 VLAN configuration

A Virtual Local Area Network ("VLAN") is a logical subnet within a larger physical network. It can extend across multiple switches.

A VLAN separates physical networks into subnets by ensuring that VLAN-enabled switches do not forward data packets into another VLAN. Devices logically connected via a VLAN remain among themselves. The use of VLANs in large physical networks is useful for controlling data traffic and securing access rights to devices.

The assignment of the subnets to a VLAN can be realized via special markings in the ethernet frames ("tagged") or statically via port assignment in the switches ("untagged").

Tagged: If the port is a tagged member of a particular VLAN, all packets in that VLAN are tagged when they leave the port. The VLAN tag is a 4-byte overhead on the standard Ethernet frame consisting of a 2-byte Tag Protocol Identifier (TPID), which is 0x8100, and a 2-byte Tag Control Information (TCI). The TCI contains a 12-bit VLAN identifier. Thus up to 4096 different VLANs can be managed.

Untagged: If a port is an untagged member of a particular VLAN, all packets in that VLAN - without a VLAN tag - are forwarded to that port.



NOTE

The following special features must be observed in the interaction of PROFINET and VLANs:

Management-VLAN

In the FLEXtra PROFINET switch, VLAN 1 is the management VLAN. The FLEXtra web interface and the PROFINET interface are only available in VLAN 1. To prevent the connection to the device from being lost, port 1 as management port in the VLAN configuration is always tagged member of VLAN 1.

AR Connection

The PROFINET interface in the FLEXtra is only available in VLAN 1. The PROFINET controller can establish the AR connection only on the ports that are members of VLAN1.

MRP

If the FLEXtra PROFINET-Switch is configured as MRP client, both MRP ring ports must be members of VLAN1 for normal operation!




NOTE


1. It is highly recommended to create VLANs and edit the VLAN membership and port-based settings before enabling the VLAN feature.
2. It is highly recommended to always use Port 1 for configuration. Port 1 is always a member of the management VLAN 1 and the web interface can always be accessed.
3. It is highly recommended to use only VLAN 1 for the PROFINET network. Only on VLAN 1 the PROFINET functionality of the Switch can be accessed.

The FLEXtra PROFINET-Switch supports VLANs, both tagged and untagged. The VLAN configuration can be configured in the "Switch" menu under "VLAN Configuration". The VLAN configuration is divided into two dialogs, which can be switched between with a button.

The device can operate as a VLAN active and VLAN inactive device. This is controlled with the switch "VLAN 802.1Q: ON/OFF".

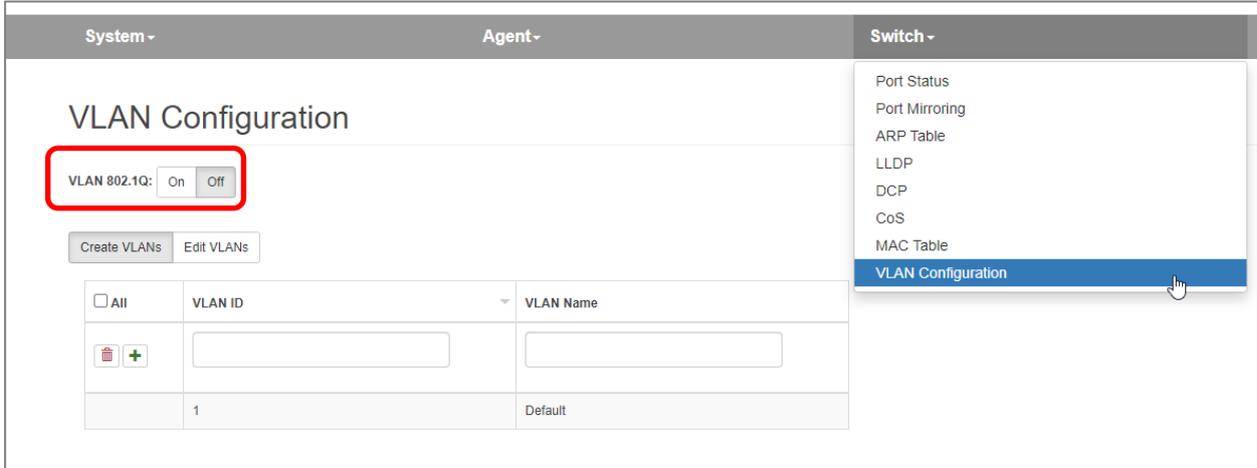

1. „Create VLANs“: Virtual LANs can be created in this dialog.

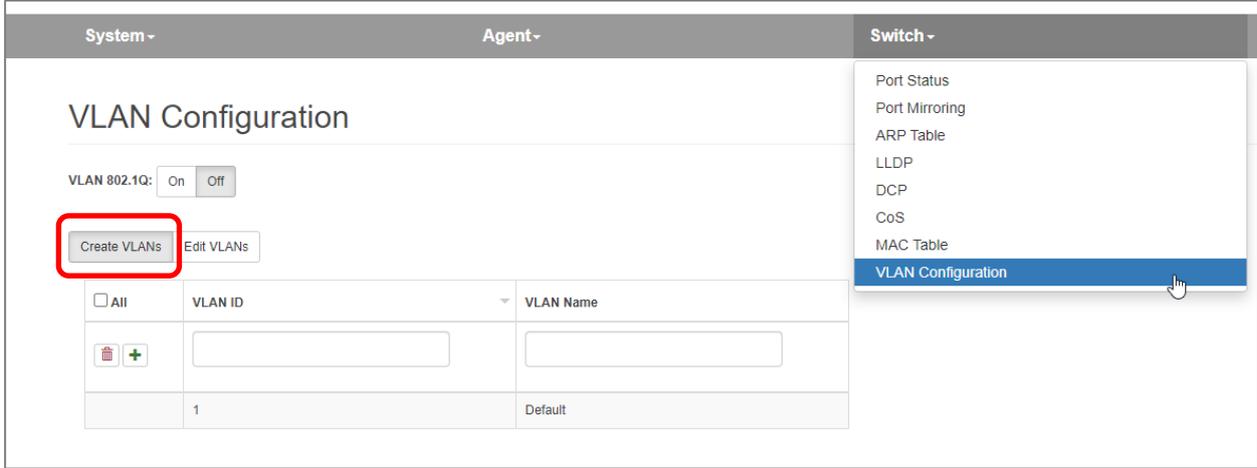

The VLAN ID can be set from 1-4095, the VLAN name is freely selectable.

The icon  is used to create the new VLAN.

The icon  can be used to delete a VLAN.

2. „Edit VLANs“: In this dialog, one or more VLANs can be assigned for each port.

VLAN Membership		Port Based Settings		
VLAN ID	Member Type	Port VID	Discard Frames	Ingress Filtering
1	U	1	-	<input type="checkbox"/>
Port 1		1	-	<input type="checkbox"/>
Port 2		1	-	<input type="checkbox"/>
Port 3		1	-	<input type="checkbox"/>
Port 4		1	-	<input type="checkbox"/>

“VLAN Membership” – In the first two columns you can see or change the membership of all ports for the selected "VLAN ID".

“VLAN ID” Current VLAN ID for which the membership configuration is displayed.

“Member Type” Port member type:

“-“ Port is not a member of the specified VLAN

“T” Port is a tagged member of the specified VLAN

“U” Port is not tagged member of the specified VLAN



Copy settings for this VLAN ID to all other ports

"Port Based Settings" In the rear 3 columns the VLAN ID and security settings can be defined for each port.

"Port VID" default port VLAN ID. When a frame arrives on a port without a VLAN ID, the default VID is applied and the frame is switched as if it had the specified VID.

"Discard Frames" Specifies what kind of frames should be discarded:

"- " All frames are accepted

"T" Tagged frames are discarded

"U" Untagged frames are discarded

"Ingress filtering" specifies whether the VID of incoming frames should be evaluated:

Active: Frames are only accepted if the VLAN ID in the Ethernet telegram matches the port VLAN ID. That is, if the port is a tagged member of VID 100 and an untagged member of VLAN 1000. It accepts frames with VID 100 and 1000, and all other VLAN tagged frames are discarded.

Inactive: All frames are accepted.

6.5 Network statistics (“Statistics” menu)

The PROFINET-Switch collects statistical data per port about the type of incoming (RX) and forwarded (TX) frames. The statistics can be displayed and reset.

6.5.1 „Statistics By Size“

In the statistics according to telegram length, both RX and TX telegrams are taken into account. The telegrams are divided into 6 areas based on their size:

0-64 Bytes, 65-127 Bytes, 128-255 Bytes, 256-511 Bytes, 512-1023 Bytes and 1024-max. (1500 Bytes).

	64	65-127	128-255	256-511	512-1023	1024-max.
Port 1	5267727	5254983	34855	21	35	38
Port 2	0	0	0	0	0	0
Port 3	0	0	0	0	0	0
Port 4	33565	7680	13839	161	455	3572
Port 5	5357694	6171926	23543	16898	42	738
Port 6	0	0	0	0	0	0
Port 7	0	0	0	0	0	0
Port 8	0	0	0	0	0	0

[✖ Clear](#)

6.5.2 „Statistic By Type“

In the statistics by message type, frames are first divided into TX (transmitted) and RX (received) frames, and the following types are also distinguished:

Unicast: Frame directed directly to a device

Multicast: Frame directed to a group of devices

Broadcast: Frame directed to all devices in the network

	RX Unicast	RX Multicast	RX Broadcast	TX Unicast	TX Multicast	TX Broadcast
Port 1	5289702	16970	0	5291606	25295	9966
Port 2	0	0	0	0	0	0
Port 3	0	0	0	0	0	0
Port 4	14053	1985	5222	10890	23367	4750
Port 5	5761201	93906	4750	5772763	18907	5210
Port 6	0	0	0	0	0	0
Port 7	0	0	0	0	0	0
Port 8	0	0	0	0	0	0

[✖ Clear](#)

6.5.3 „Statistics By Error“

The PROFINET switch collects statistical data about arrived frames with transmission errors per port.

A distinction is made between:

- Undersize
- Fragment
- Oversize
- Jabber
- CRC

	Undersize	Fragment	Oversize	Jabber	CRC
Port 1	0	0	0	0	0
Port 2	0	0	0	0	0
Port 3	0	0	0	0	0
Port 4	0	0	0	0	0

[✖ Clear](#)

7 Status and control in the PLC

By integrating the FLEXtra PROFINET-Switch into a PROFINET project, IO data is available in the PLC for status indication and for controlling the switch.

The operating status of the switch, the 4 digital inputs and the 16 ports can be queried in the input image. The input image for the status display of the switch occupies 17 bytes:

Byte/Bit	7	6	5	4	3	2	1	0
Input Byte 0	PROFINET switch ready for operation	SD-Card inserted and active	PS 2 supply present	PS 1 supply present	DI 4 status	DI 3 status	DI 2 status	DI 1 status
Input Byte 1 for Port 1	Transmission active	0	0	0	0	0	00 = not connected 01 = 10MBps 10 = 100MBps 11 = 1000Mbps	
Input Byte 2 for Port 2	Transmission active	0	0	0	0	0	00 = not connected 01 = 10MBps 10 = 100MBps 11 = 1000Mbps	
...							...	
Input Byte 16 for Port 16	Transmission active	0	0	0	0	0	00 = not connected 01 = 10MBps 10 = 100MBps 11 = 1000Mbps	

With the output image the port errors can be reset, the two digital outputs can be switched and all ports can be disabled or enabled. The output image for controlling the switch occupies 3 bytes:

Byte/Bit	7	6	5	4	3	2	1	0
Output Byte 0	Reset port errors	-	-	-	-	-	switch DO 2	Switch DO 1
Output Byte 1	Port 8 disable/enable	Port 7 disable/enable	Port 6 disable/enable	Port 5 disable/enable	Port 4 disable/enable	Port 3 disable/enable	Port 2 disable/enable	Port 1 disable/enable
Output Byte 2	Port 16 disable/enable	Port 15 disable/enable	Port 14 disable/enable	Port 13 disable/enable	Port 12 disable/enable	Port 11 disable/enable	Port 10 disable/enable	Port 9 disable/enable

Whether a port can be locked and unlocked via the output image and the bit state for locking and unlocking can be set in the configuration of the PROFINET switch under the "Port X Output Function" parameter for each port.

Settings

- Diagnostic at PS1 failure
- Diagnostic at PS2 failure
- Port 1 DI function: no action
- Port 1 DO function: no action
- Port 1 PN output function: disable port if bit is 1, enable if bit is 0
- Port 2 DI function: no action
- Port 2 DO function: no action
- Port 2 PN output function: enable port if bit is 1, disable if bit is 0
- Port 3 DI function: no action
- Port 3 DO function: no action
- Port 3 PN output function: no action



NOTE

Switching the ports via the output image has no function if the port is switched off in the port settings (see Chap. 5.4).




NOTE

The FLEXtra PROFINET switch FO 10-Port has no physical inputs or outputs. However, the input and output image is still present.

8 Status and control via digital inputs/outputs

The "FLEXtra PROFINET Switch 16-Port" and the "FLEXtra PROFINET Switch FO 16-Port" have 4 digital inputs and 2 digital outputs for 24V on the back. The "FLEXtra PROFINET Switch FO 10-Port" has no inputs or outputs.

The inputs can block or release any ports. In the parameterization of the switch in the PROFINET configurator, it can be set for each port whether it is to be blocked or enabled by one of the digital inputs.

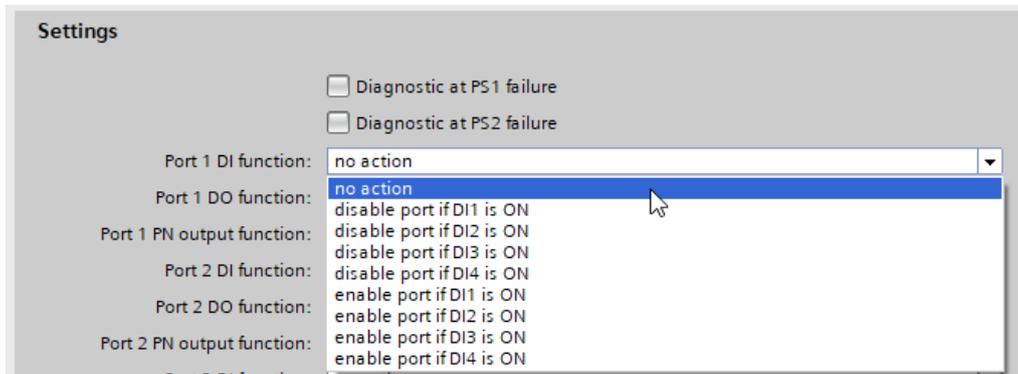


NOTE

Locking or releasing a port via the digital inputs has no function if the port is switched off in the port settings (see Chap. 5.4).

The state of the inputs can always be read out in the input image in byte 0 of the switch, regardless of its selected function (see Chap. 7).

The outputs can display the state of any port. In the parameterization of the switch in the PROFINET configurator it can be set for each port whether the connection state or an error state of the port should switch the output. The port states are "ORed" for each output. If a port has the parameterized state, the output is set.

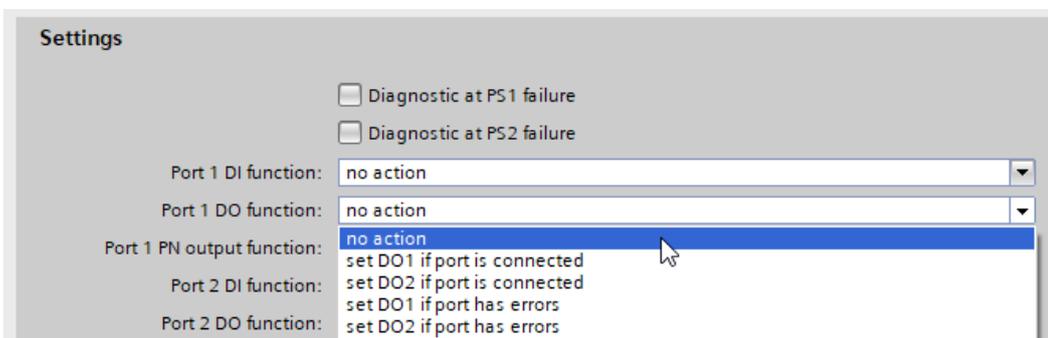

NOTE

If outputs 1 or 2 are used, inputs 1 or 2 are no longer available.

9 PROFINET FAQ

9.1 Why do you need a PROFINET switch for a PROFINET network?

A PROFINET switch handles PROFINET frames with the highest priority and ensures that frame loss doesn't occur and that jitter in the transmission remains minor. That secures the PROFINET transmission and allows precise regulating in PROFINET systems.

A PROFINET switch supports mechanisms for neighborhood detection (LLDP protocol) in order to detect and check the topology of the network. This ensures that the setup and the network wiring of the system are correct.

PROFINET switch supports device replacement without exchangeable medium. If a PROFINET node needs to be replaced, new device is automatically recognized based on its position in network by the CPU, and thus it can be configured without the need for additional actions. This reduces the down time of the malfunction device significantly.

Because many different devices are often installed into automation systems, the "Finding devices via LED flash" function supports the easy search for a participant.

In order to improve the reliability of networks, PROFINET switches support the ring redundancy technology MRP (Media Redundancy Protocol).

However, the operation of a PROFINET network is also possible with unmanaged switches.

9.2 Is the PROFINET switch "real time-compatible"?

The PROFINET switch is "real time-compatible" and supports the PROFINET real time class 2 for cyclical data exchange. PROFINET is generally differentiated into two main real time classes: RT and IRT.

The "real time capability" of an industrial bus system generally involves the chronological precision of the cyclical IO transmission. For complex and distributed automation tasks, especially in the drive control area, it is important that the cyclical data transmission always takes place consistently. Longer interruptions due to other Ethernet traffic, for example, video cameras or project transmissions, should not influence the PROFINET IO cycle where possible.

PROFINET RT (real time) uses the standard technologies of managed switches (e.g. QoS) to always prioritize important Ethernet frames of bus communication in relation to chronologically non-critical frames.

PROFINET IRT (isochronous real time) uses special PROFINET switches to keep the jitter and the rhythm of the IO cycle as exact as possible in the network and to ensure a synchronous rhythm and the best transmission possible.

The Helmholz PROFINET switch supports PROFINET RT, but not IRT.

9.3 What do the LEDs BF and SF mean?

The “BF” LED shows logical “bus errors”, for example, that the device has not received a configuration, the configuration is defective, or no PROFINET communication is possible at all (network error).

The “SF” LED shows “collective errors”. This can include, for example, an existing PROFINET diagnosis.

9.4 What is “Device exchange during operation”, and what role does the PROFINET switch play here?

If a PROFINET participant malfunctions while in operation, a replacement device is detected following installation on the basis of its position in the topology (by the PROFINET neighbors) and is automatically provided with its IP address and its PROFINET name. The CPU can then configure the replacement device and restart. The neighboring PROFINET devices, for example, the switch, must this purpose support PROFINET in order to enable this function.


9.5 Why should PROFINET devices have PROFINET certification?

The PNO certification is carried out by accredited testing labs and is standardized by the PNO. PROFINET certification should ensure both the function of the PROFINET components in accordance with standards and the interoperability of various manufacturers in a PROFINET network.

9.6 What is behind the PROFINET conformance classes A, B, C?

PROFINET is divided into conformance classes (CC). The conformance classes define sensible function scopes and are thus decision-making criteria for system operators when using PROFINET components.

With prior definition of an application in a CC, the user can make a selection of components with clearly defined minimum properties.

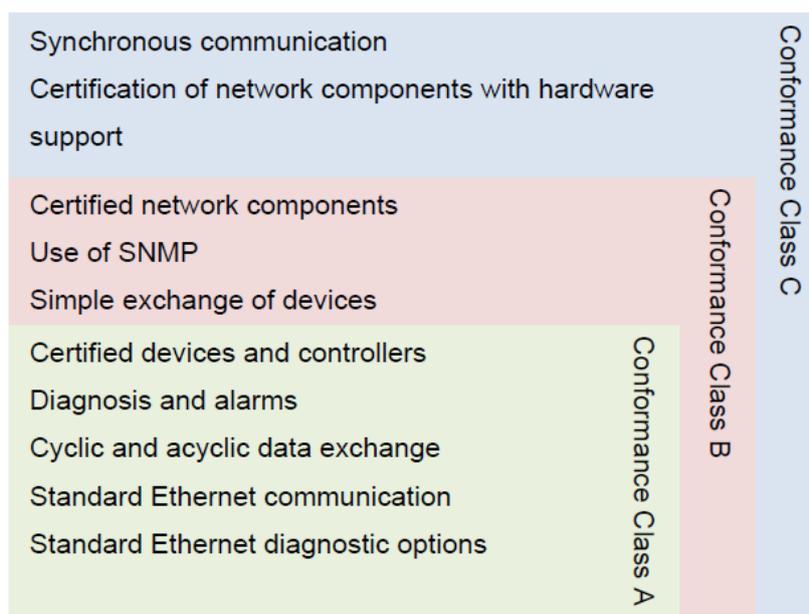

From the PNO document “PROFINET Planning Guideline (Order no.: 8.061)”

You can find more information on the conformance classes in the PNO document “The PROFINET IO Conformance Classes - Guidelines for PROFINET IO (Order no.: 7.041)”.

9.7 Can the PROFINET switch also transmit 1 GBit?

The PROFINET protocol is specified for 100 Mbit/s in normal applications and PROFINET end devices usually only have 100 Mbit connections. However, transmission of PROFINET telegrams via a Gigabit connection, e.g. between two Gigabit switches, is possible and permitted.

9.8 Which Ethernet cable types can be used for PROFINET?

The conformance classes B and C presume Ethernet cable in accordance with IEC61784-5-3.

In conformance class A, other cables (see PNO document “CC-A Cabling Guide”) and wireless connections can also be used.

9.9 Can PROFI-safe be transmitted via the PROFINET switch?

Yes, the PROFI-safe protocol classifies all components between the PROFI-safe controller and the PROFI-safe device as “black channel”. Any number of network participants and components can thus be used in the PROFINET route. If transmission disruptions should occur, the PROFI-safe components switch to a secure status

9.10 Why does the PROFINET switch have its own IP address and a PROFINET name?

The PROFINET switch is a managed switch. The IP address is necessary to be able to address the switch as an active infrastructure component. PROFINET switch can be reached via IP address over Web browser (web interface) or by other PROFINET participants (e.g. a CPU or a programming device can configure the switch and read out information from the switch).

For the purposes of simplifying the IP address in the PROFINET, a device name can be used that is then synonymous in a project for the IP address.

9.11 What are I&M data?

For PROFINET and PROFIBUS, I&M stands for “Identification and Maintenance”. The I&M data contain information about the PROFINET participants. Some I&M fields are programmed by the manufacturer (e.g. order number, serial number, ...), and fields can be used by users in order to store their own information in the module (e.g. location, service contact, ...)

The I&M data of all PROFINET participants can be read out and evaluated in the automation network with standard functions. The PROFINET switch has appropriate I&M data records.

9.12 Can I also use the PROFINET switch in other industrial networks without PROFINET?

PROFINET is based on the Ethernet standard and the PROFINET switch can be used in normal TCP/IP networks, especially in industrial networks, as a managed switch. In the process, the PROFINET-specific functions of the PROFINET switch are not addressed.

General Ethernet functions can be read out and configured through the switch web interface.

9.13 What happens with a PROFINET participant when the power supply fails?

PROFINET participants mostly have 2 ports for the PROFINET cabling. The two ports are connected with one another by an internal 2-port switch component. If the power supply of a PROFINET

participant fails, the communication is interrupted at this point in a network line. One can get around this problem with ring cabling using MRP technology.

If the power supply of a PROFINET switch fails, the communication with all participants connected to this switch is no longer possible.

This behavior is clearly different from that of PROFIBUS networks!

9.14 Why is “Port Mirroring” necessary?

PROFINET is a complex communication protocol. In some situations, it may be necessary to read and interpret the frame traffic with a protocol analyzer.

In order to be able to monitor PROFINET network expensive coupling hardware which is looped into the line can be used. Alternative is Port mirroring feature configured on free port. The monitor port transmits all frames from mirrored port of the switch as a copy. A device or PC can then capture packets on monitor port with the corresponding analysis software.

9.15 Do the PROFINET switches support TSN?

TSN ("Time Sensitive Networking") is currently not yet supported by the Helmholtz PROFINET switches.

9.16 More information on PROFINET

More information on PROFINET can be found in the documentation “PROFINET Planning Guideline (Order no.: 8.061)”, “PROFINET Installation Guideline (Order no.: 8.071)” and the “PROFINET Commissioning Guideline (Order no.: 8.081)”, which are available from PNO (<https://www.profibus.com/>).

10 Technical data

10.1 FLEXtra PROFINET-Switch 16-port

Order number	700-855-16P01
Name	FLEXtra PROFINET-Switch 16-Port, managed, 100/1000Mbit
Scope of delivery	FLEXtra PROFINET-Switch 16-Port with power supply plug
Dimensions (D x W x H)	78 x 125 x 112 mm
Weight	Ca. 550 g
PROFINET/Ethernet interfaces (X1)	
Connection	16 x RJ45 integrated Switch
Transmission rate	10/100/1000 Mbps
Protocol	PROFINET IO Device as defined in IEC 61158-6-10
Features	PROFINET Conformance Class B (<i>in Preparation</i>), Media Redundancy (MRP), automatic addressing (DCP), topology detection (LLDP), diagnostic alarms, VLAN, SNMP V2/V3, Port-Mirroring, Port statistics
Digital IO	
Inputs	4, Type 3 as of DIN EN 61131-2
Outputs	2, 500mA 24V DC, with electronic fuse
Status indication	
Function status	4 LEDs
Ethernet status	16 LEDs (bi-colored)
Power supply	
Operating voltage	2x DC 24 V, 18 – 30 V DC, redundant
Current draw	max. 400 mA with DC 24 V
Power dissipation	Max. 9,6 W
Ambient conditions	
Ambient temperature	0° C to +60° C
Transport and storage temperature	-40° C to +85° C
Relative humidity	95% without condensation
Protection rating	IP 20
Mounting position	As desired
Compliance	
Approvals	CE

10.2 FLEXtra PROFINET-Switch FO 16-port

Order number	700-856-16F41
Name	FLEXtra PROFINET-Switch FO 16-Port, managed, 100/1000Mbit
Scope of delivery	FLEXtra PROFINET-Switch FO 16-Port with power supply plug
Dimensions (D x W x H)	78 x 125 x 112 mm
Weight	Ca. 550 g
PROFINET/Ethernet interfaces (X1)	
Connection	12 x RJ45 4 x Fiber Optic (FO) for SFP Transceiver modules, Single mode or Multimode integrated Switch
Transmission rate	RJ45: 10/100/1000 Mbps SFP: 1000 Mbps
Protocol	PROFINET IO Device as defined in IEC 61158-6-10
Features	PROFINET Conformance Class B (<i>in Preparation</i>), Media Redundancy (MRP), automatic addressing (DCP), topology detection (LLDP), diagnostic alarms, VLAN, SNMP V2/V3, Port-Mirroring, Port statistics
Digital IO	
Inputs	4, Type 3 as of DIN EN 61131-2
Outputs	2, 500mA 24V DC, with electronic fuse
Status indication	
Function status	4 LEDs
Ethernet status	16 LEDs (bi-colored)
Power supply	
Operating voltage	2x DC 24 V, 18 – 30 V DC, redundant
Current draw	max. 400 mA with DC 24 V
Power dissipation	Max. 9,6 W
Ambient conditions	
Ambient temperature	-40° C to +75° C
Transport and storage temperature	-40° C to +85° C
Relative humidity	95% without condensation
Protection rating	IP 20
Mounting position	As desired
Compliance	
Approvals	CE

10.3 FLEXtra PROFINET-Switch FO 10-port

Order number	700-856-8FO21
Name	FLEXtra PROFINET-Switch FO 10-Port, managed, 100/1000Mbit
Scope of delivery	FLEXtra PROFINET-Switch FO 10-Port with power supply plug
Dimensions (D x W x H)	78 x 93 x 112 mm
Weight	Ca. 420 g
PROFINET/Ethernet interfaces (X1)	
Connection	8 x RJ45 2 x Fiber Optic (FO) for SFP Transceiver modules, Single mode or Multimode integrated Switch
Transmission rate	RJ45: 10/100/1000 Mbps SFP: 1000 Mbps
Protocol	PROFINET IO Device as defined in IEC 61158-6-10
Features	PROFINET Conformance Class B (<i>in Preparation</i>), Media Redundancy (MRP), automatic addressing (DCP), topology detection (LLDP), diagnostic alarms, VLAN, SNMP V2/V3, Port-Mirroring, Port statistics
Status indication	
Function status	4 LEDs
Ethernet status	10 LEDs (bi-colored)
Power supply	
Operating voltage	2x DC 24 V, 18 – 30 V DC, redundant
Current draw	max. 385 mA with DC 24 V
Power dissipation	Max. 9,2 W
Ambient conditions	
Ambient temperature	0° C to 60° C
Transport and storage temperature	-20° C to 80° C
Relative humidity	95% without condensation
Protection rating	IP 20
Mounting position	As desired
Compliance	
Approvals	CE